


STEP 1


SUSPENDING busSTRUT

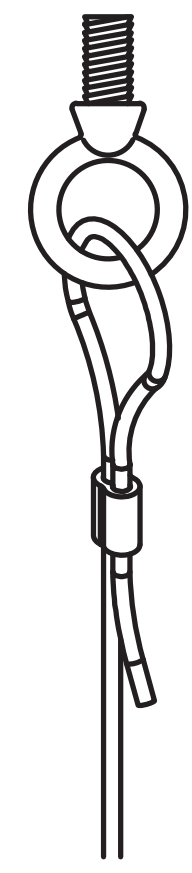

1 SUSPEND CABLES (CG-XX)


ATTACH CABLE ASSEMBLY TO STRUCTURE

*It is the contractor and/or engineer's responsibility to determine correct connection to structure (beam clamp, etc).

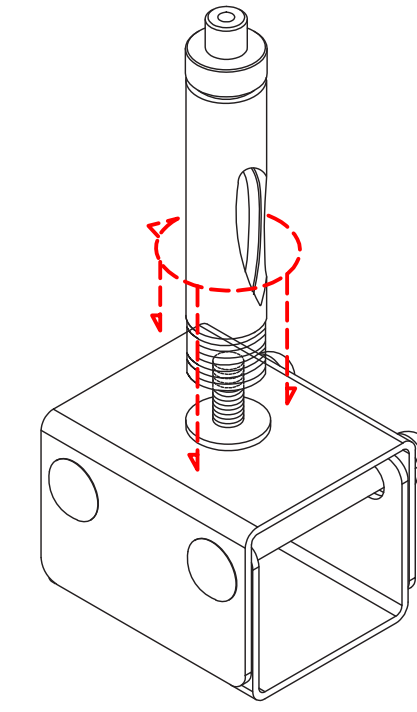


2 ASSEMBLE HANGERS (HM-S)

ASSEMBLE HANGERS AND ATTACH CABLE GLIDE

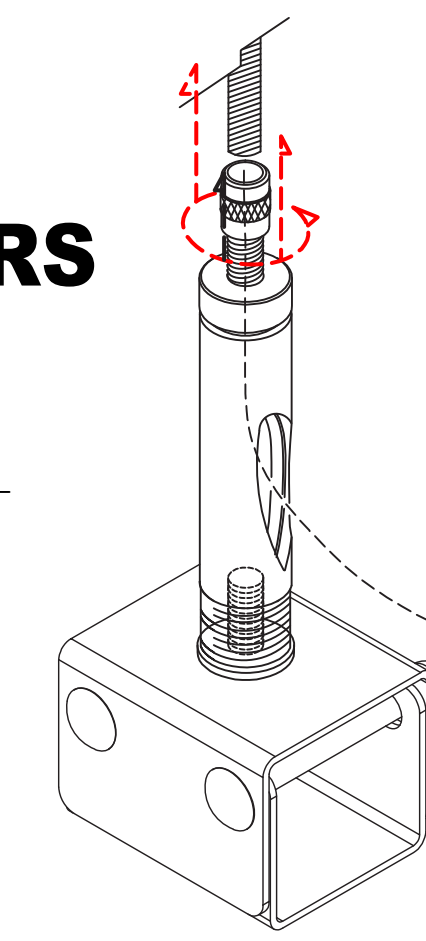

3 ATTACH HANGERS TO CABLES (CG-XX)

FEED CABLES THROUGH GLIDE TO ATTACH

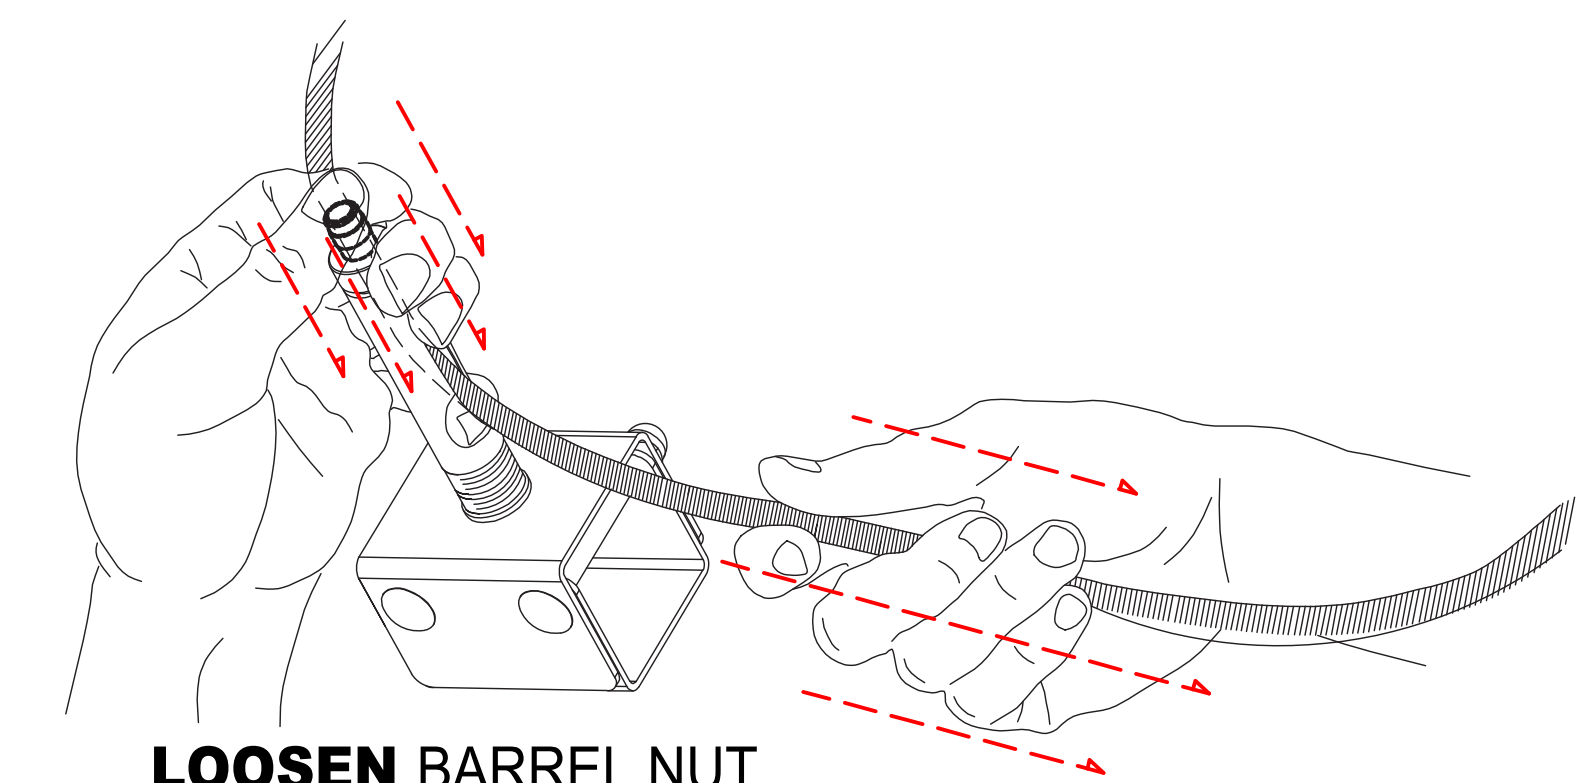

LOOSEN BARREL NUT
PUSH CABLE THROUGH
PULL CABLE FOR SLACK

SLIDE busSTRUT THROUGH SUSPENDED HANGERS

Assemble

Create cable suspended runs of busSTRUT. Usually, these are running perpendicular to structural joists. Insert busSTRUT lengths through hangers/crossovers working from FINISHED HEIGHT.

FINISHED HEIGHT

*It is the contractor and/or engineer's responsibility to determine correct connection to structure (beam clamp, etc).

LEVEL busSTRUT AND TRIM CABLE

FINISHED HEIGHT

CUT CABLE
Leave enough pass through cable for future leveling

BE SURE TO FOLLOW busSTRUT MOUNTING RULES (SEE busSTRUT shop drawings)

STEP 2

INSERT JOINERS

ATTACH JOINERS TO EACH END OF CONNECTING busSTRUT

JOINERS (M-JB)

Joiners are used to mechanically and electrically connect individual busSTRUT lengths.

TIGHTEN JOINERS

TIGHTEN SET SCREWS ON THE BOTTOM OF THE JOINER

Joiners require 3/32 Hex key for tightening set screws

ATTACH INSERT

ATTACH JOINERS TO EACH END OF CONNECTING busSTRUT

Line up center of insert with etched centerline on joiner sleeve


JOINER INSERT (M-JI-X)

A single piece unit that is installed with two knobs, one must be fully turned in each abutting length. As a result, power can continue to flow from one length to the next.

Turn the first knob

Squeeze tightly on the opposite side, then turn the second knob to secure the electrical connection.

**Installation Instruction Guidelines are provided only as that, informative guidelines. Defer to architectural/engineering drawings tailored to the specific project.

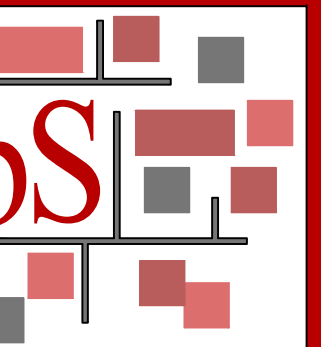

busSTRUT

805 Hilldowne Road
Suite C
Westerville, OH
43081
TEL: 614.933.8695
E-MAIL: INFO@BUSSTRUT.COM
WWW.BUSSTRUT.COM

DESIGNED BY

LARRY GELLERT

CHECKED BY

JOHN LOCH

DRAWN BY

JOHN LOCH

DATE

10/15/2024

FOR

BID / REVIEW

TYPICAL
busSTRUT Installation Instructions

busSTRUT SHOP DRAWING SET (ONLY)
NOT A REPLACEMENT FOR ARCHITECTURAL / ENGINEERING OR ELECTRICAL DRAWINGS


NO.	DATE	PERSON	DESCRIPTION
XX	XXXX	XXXX	PERSON DESCRIPTION

PAPER SIZE: ARCH E (48x36)
NOT TO SCALE
DRAWING NUMBER
E-b01


STEP 3

INSTALLING CROSSOVERS DROPPING ON

Crossovers can be dropped onto suspended busSTRUT to create an intersection with a perpendicular run of busSTRUT.

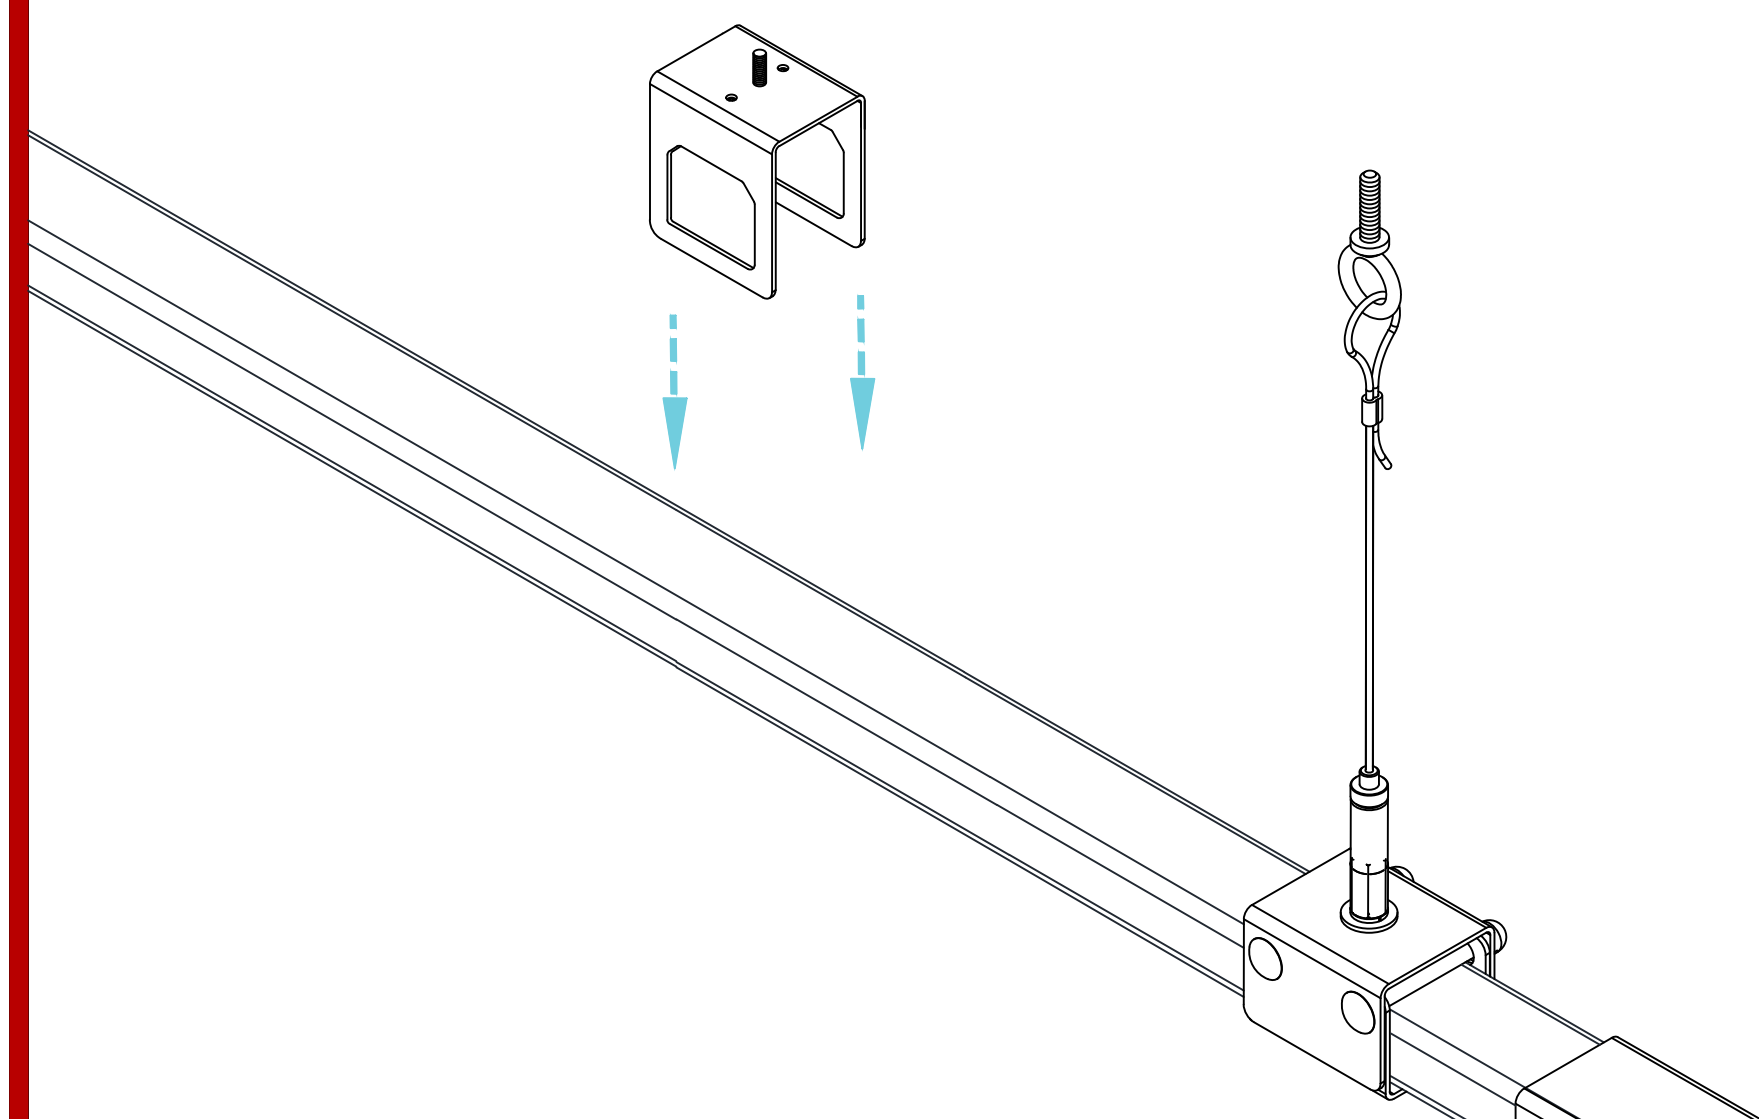


Slide perpendicular runs of busSTRUT through the crossover and tighten the set screws.

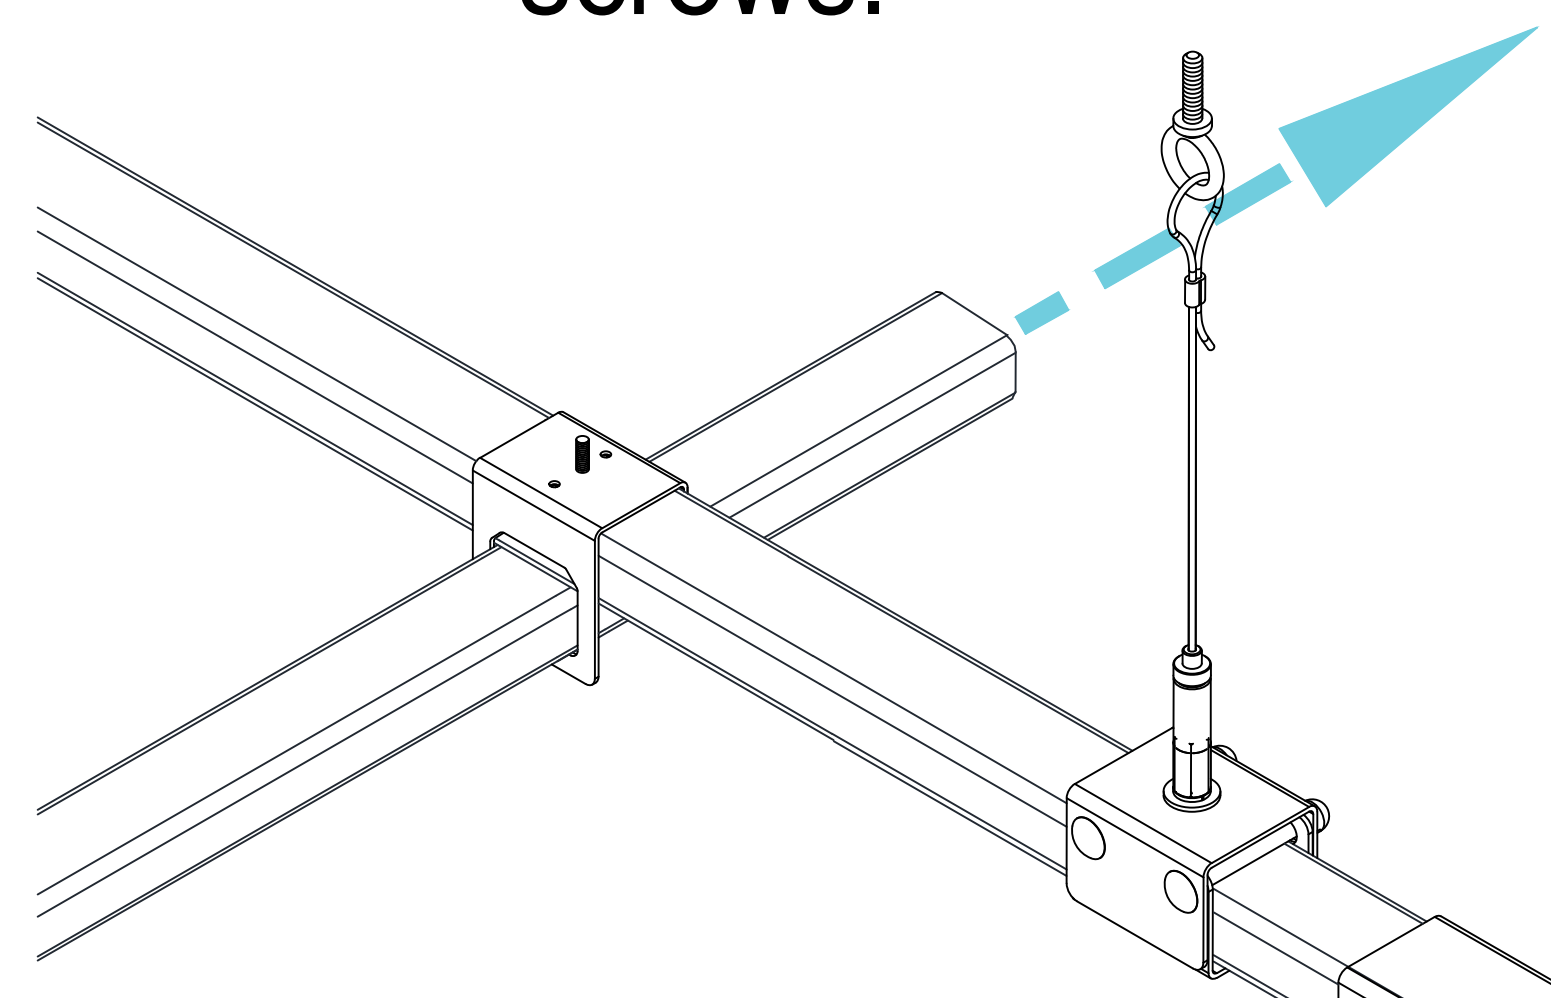

SLIDING ON

Crossovers can be slid into position and lifted to create perpendicular bridges.

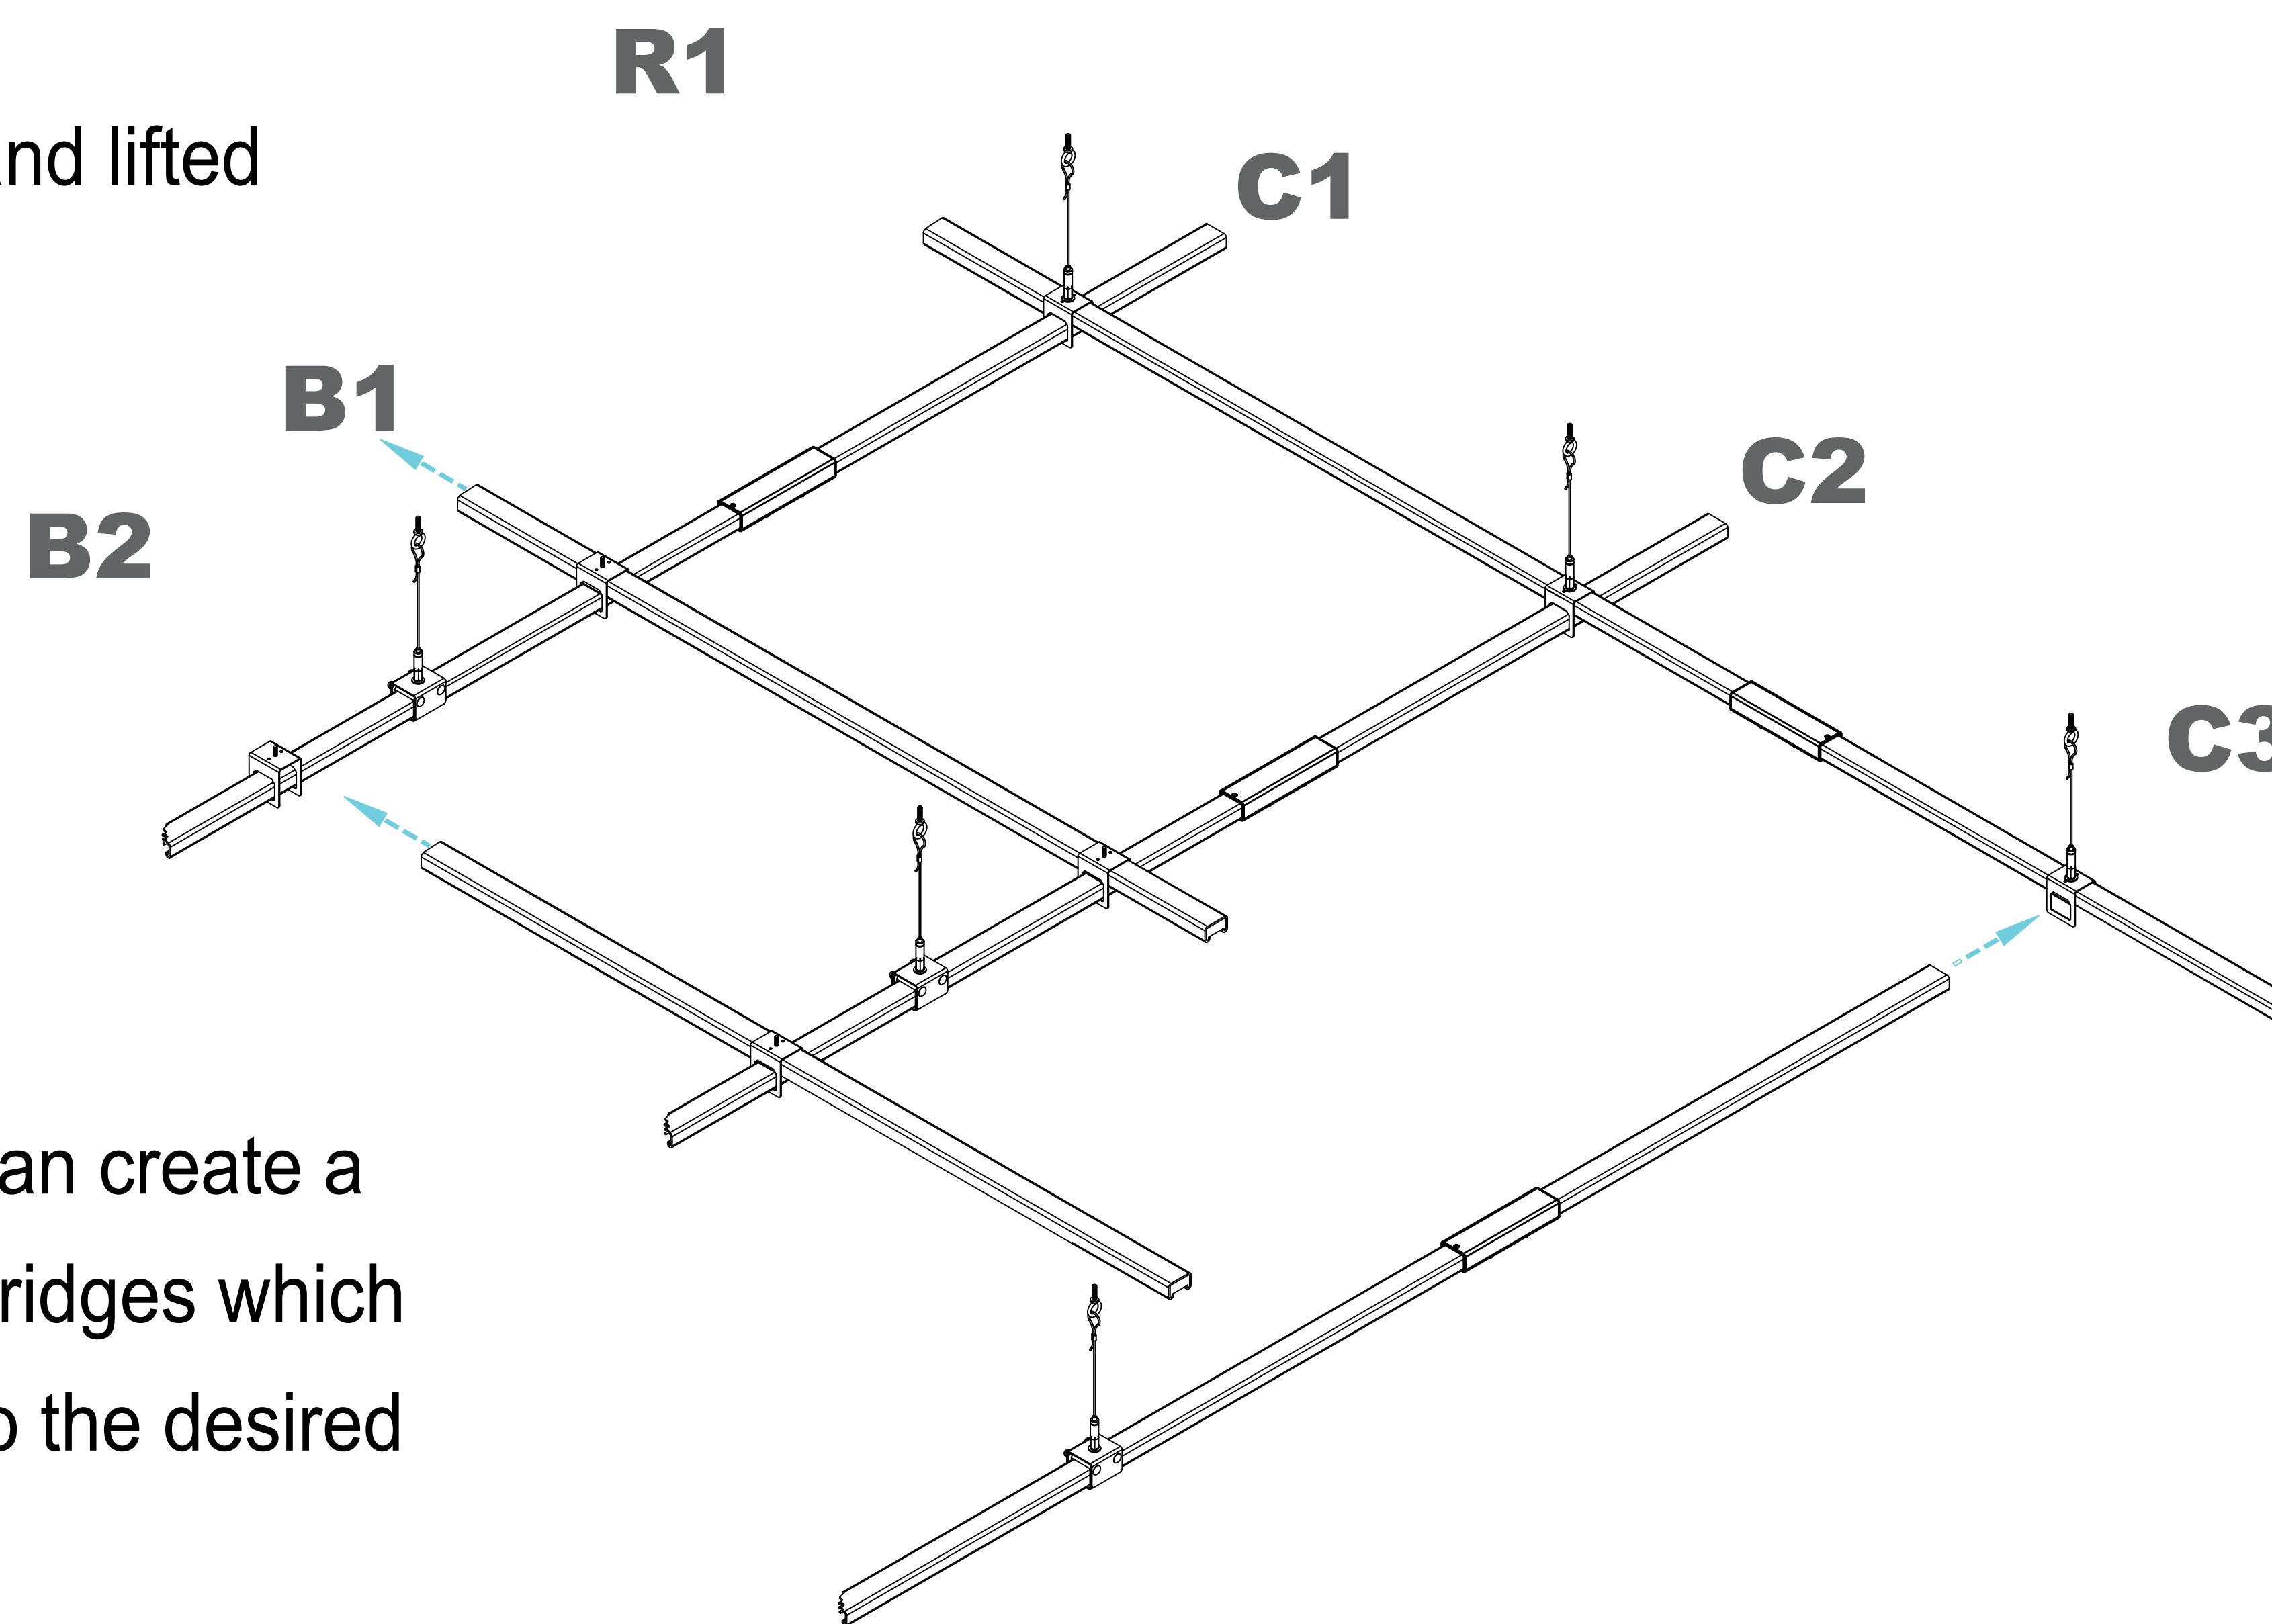


Perpendicular runs can create a full grid or be short bridges which are easily moved into the desired position.


STEP 4A

SLIMLINE JUMPER

Make sure that the slimline crossover is tightened before attaching the slimline jumper.

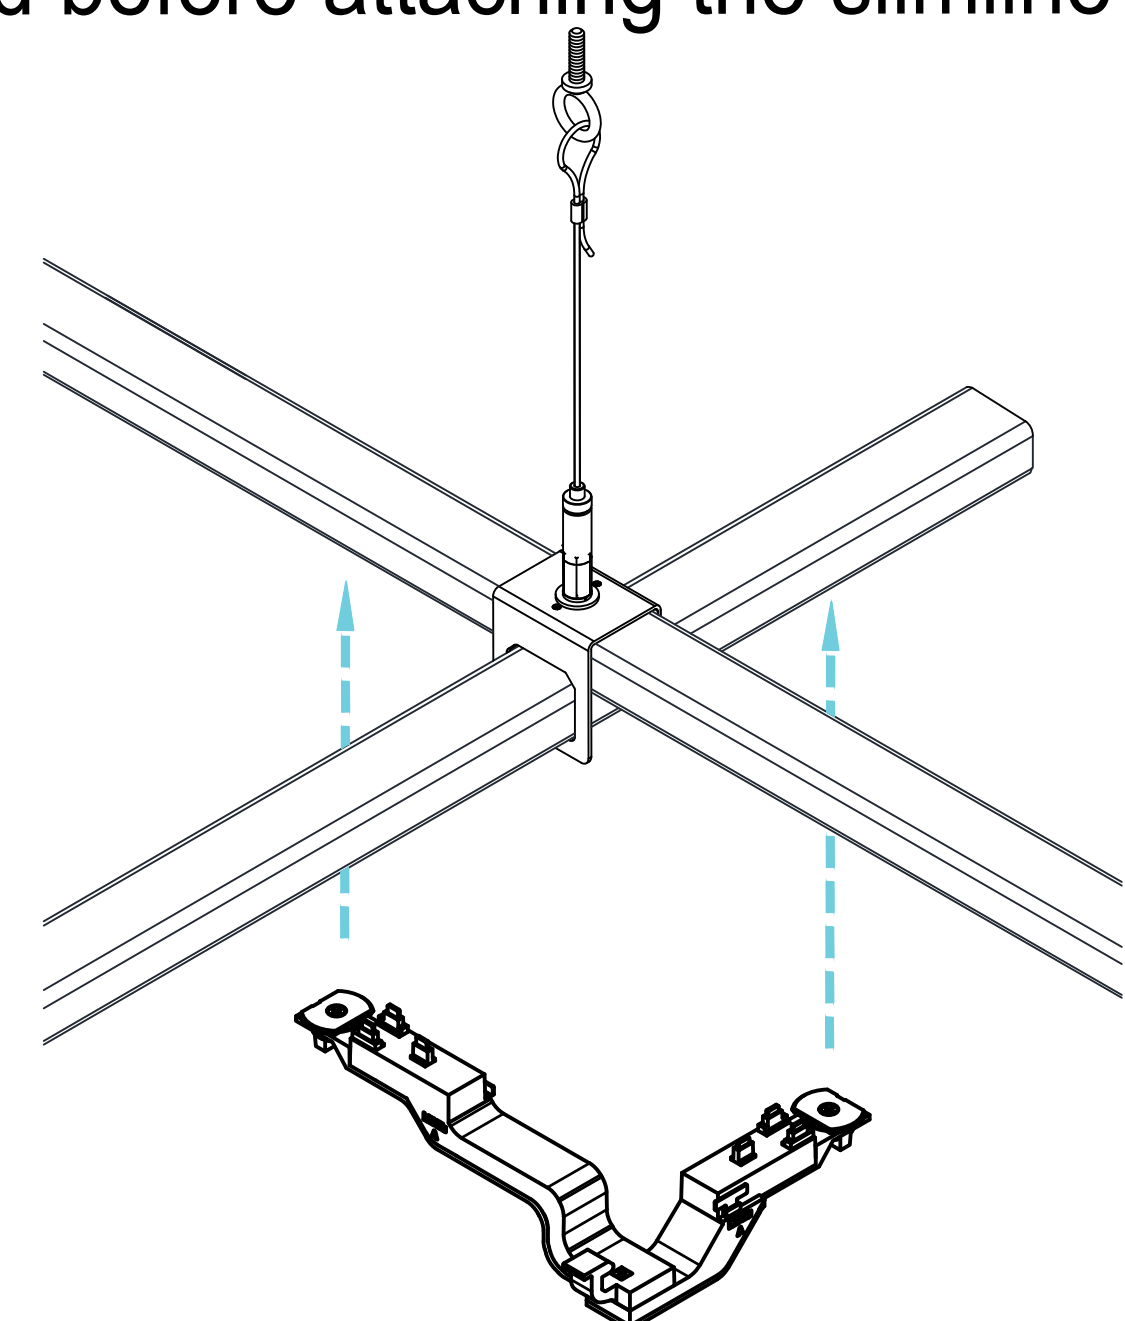


First, clip the jumper to the crossover.

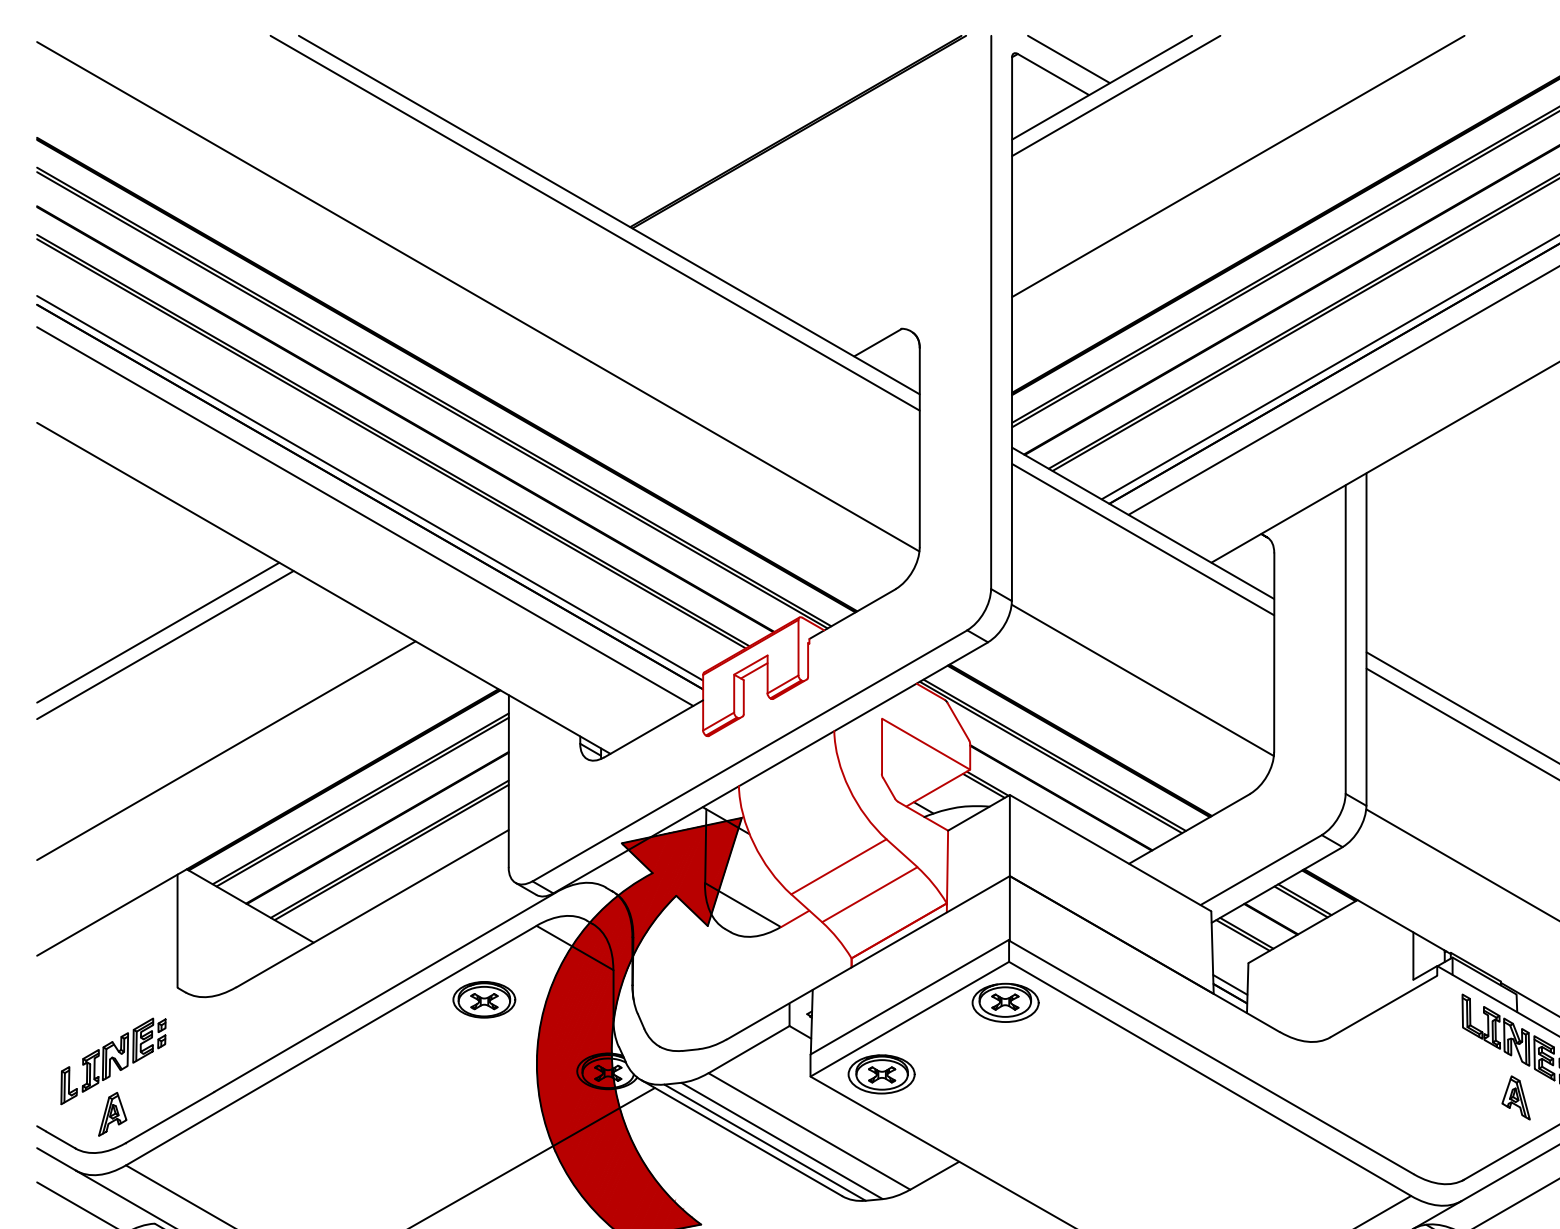


SLIMLINE JUMPER (MD2020-UNIV-IJ2-B-X)

A single piece unit that is installed with two knobs, one must be fully turned in each abutting length. As a result, power can continue to flow from one length to the next.

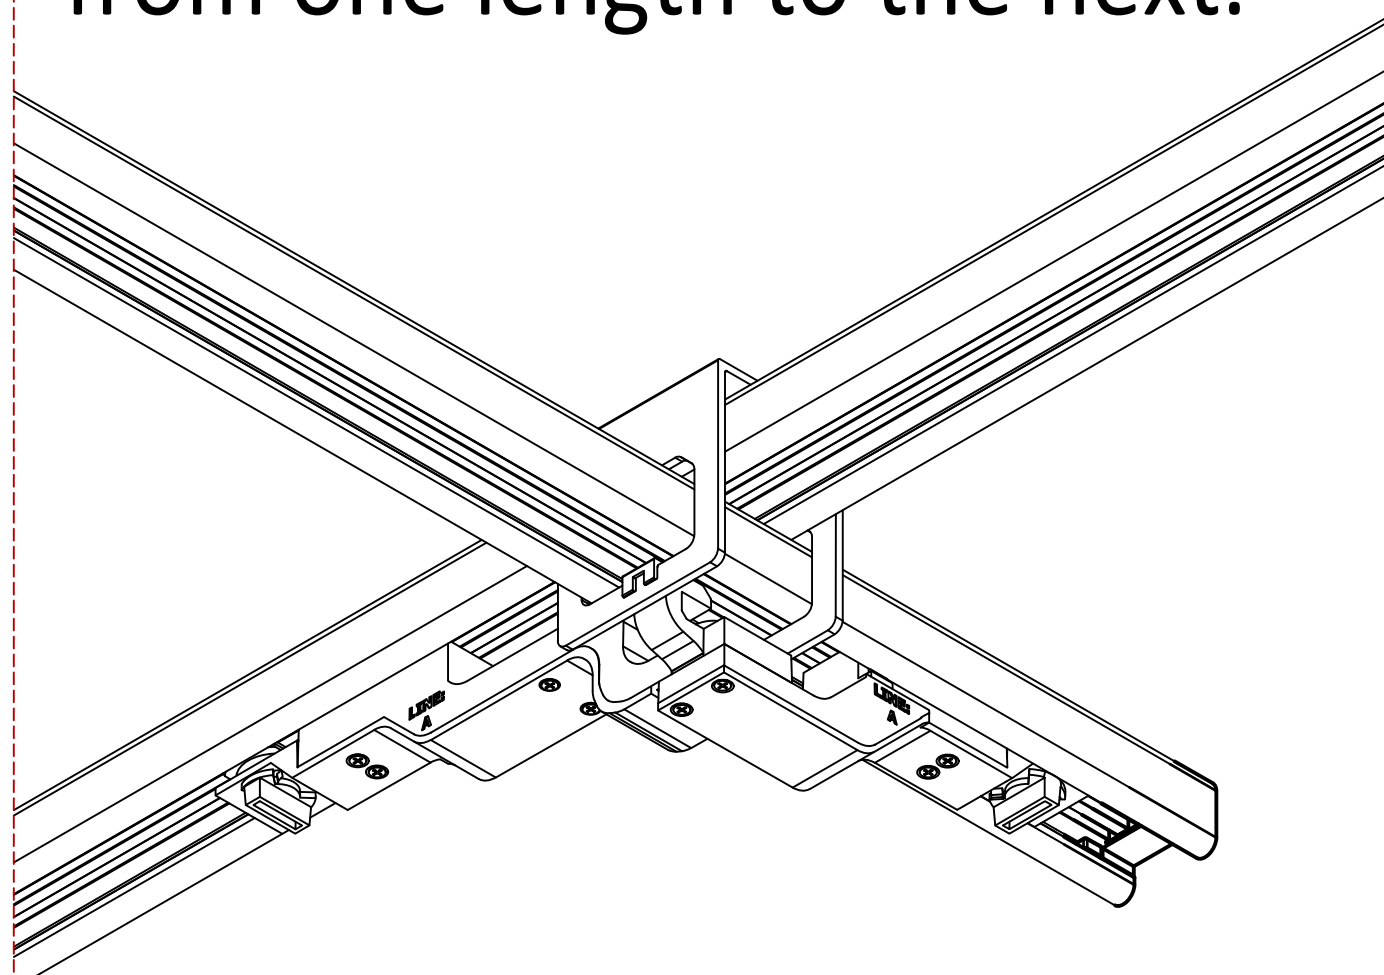

Seat the jumper into the busSTRUT by squeezing tightly on one side and turning the knob. Then, turn the other knob to complete the circuit.

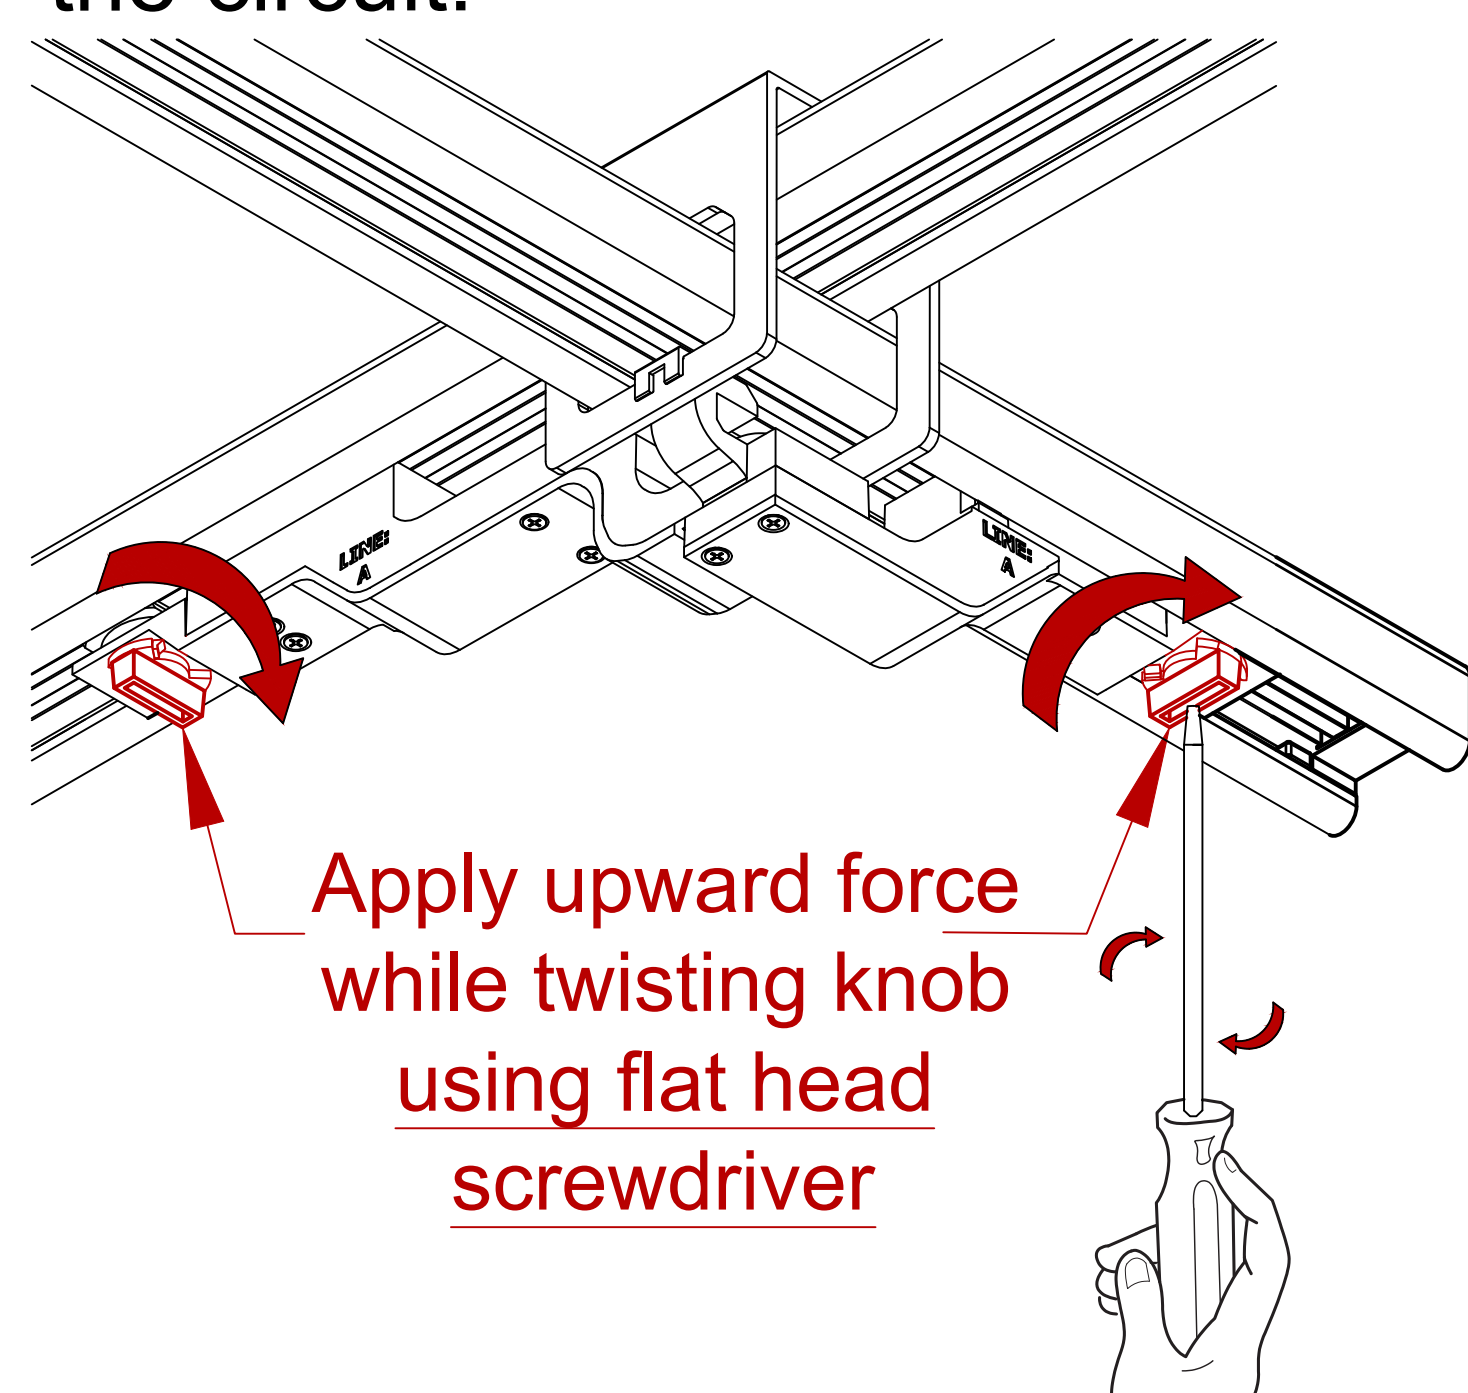


Apply upward force while twisting knob using flat head screwdriver

STEP 4B

LINE FEEDS


Install line feeds on busSTRUT to power the configuration.

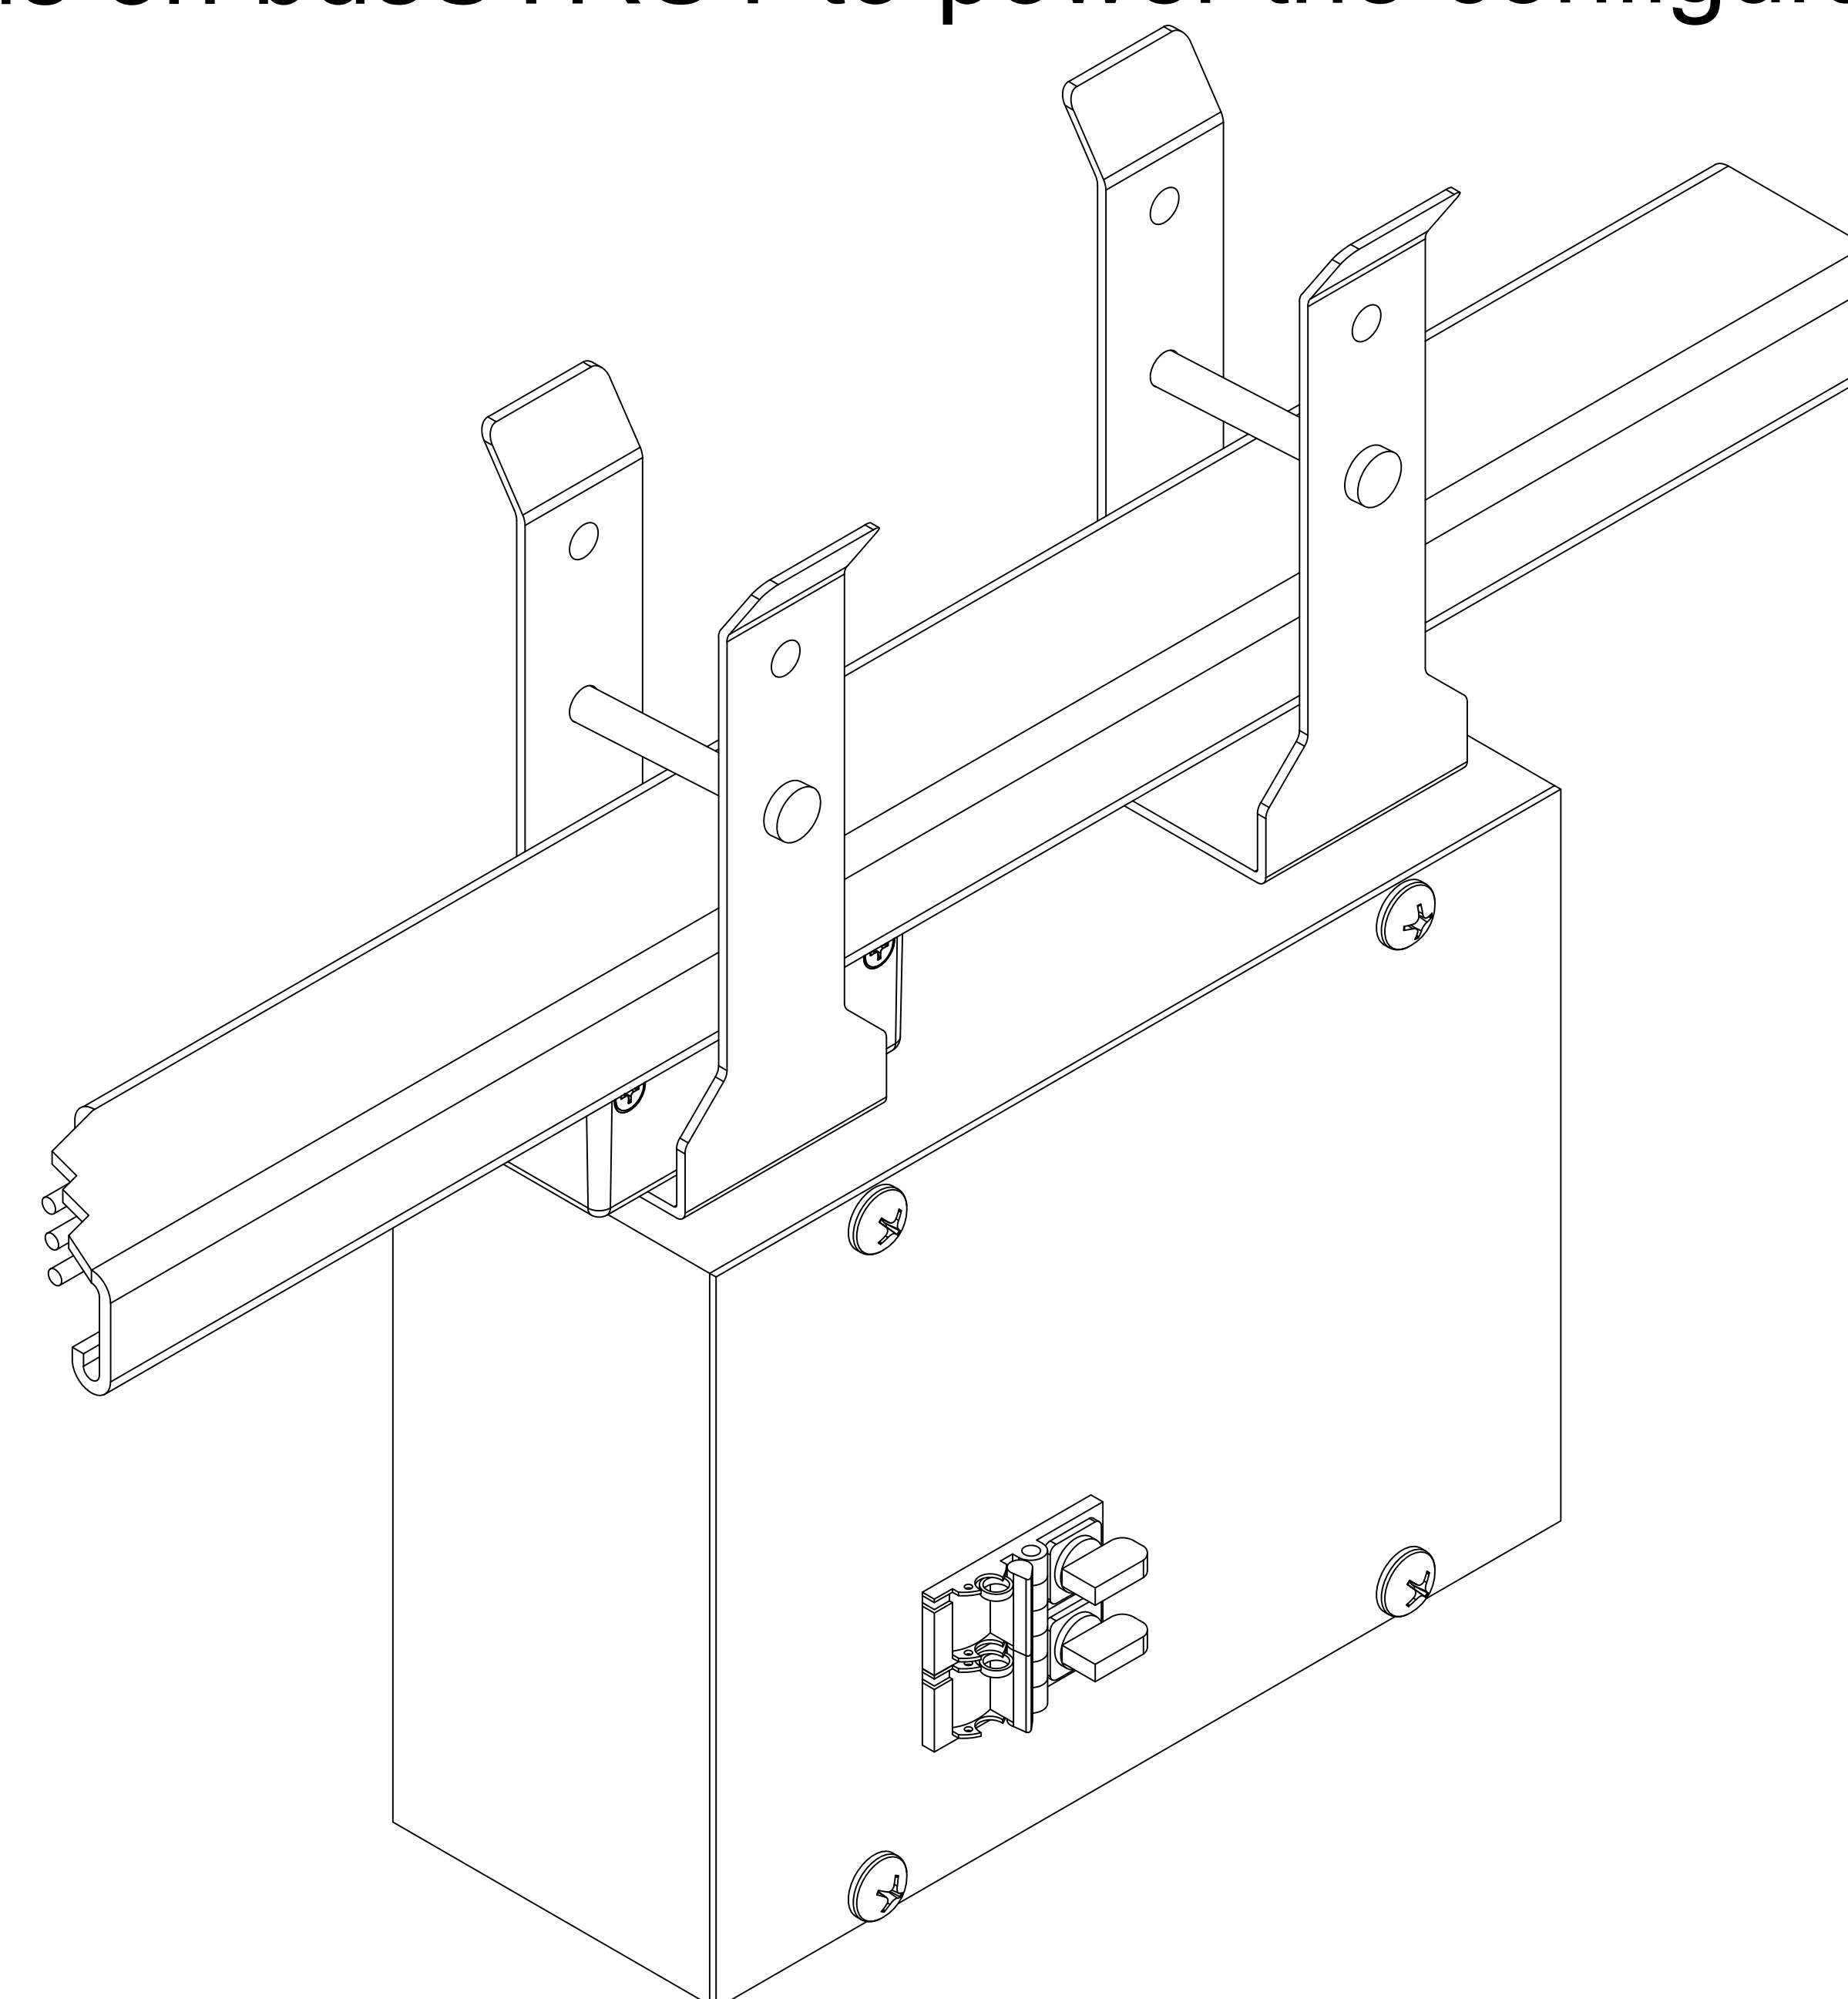

20A LINE FEED

Shown on single decked busSTRUT

busSTRUT Parts

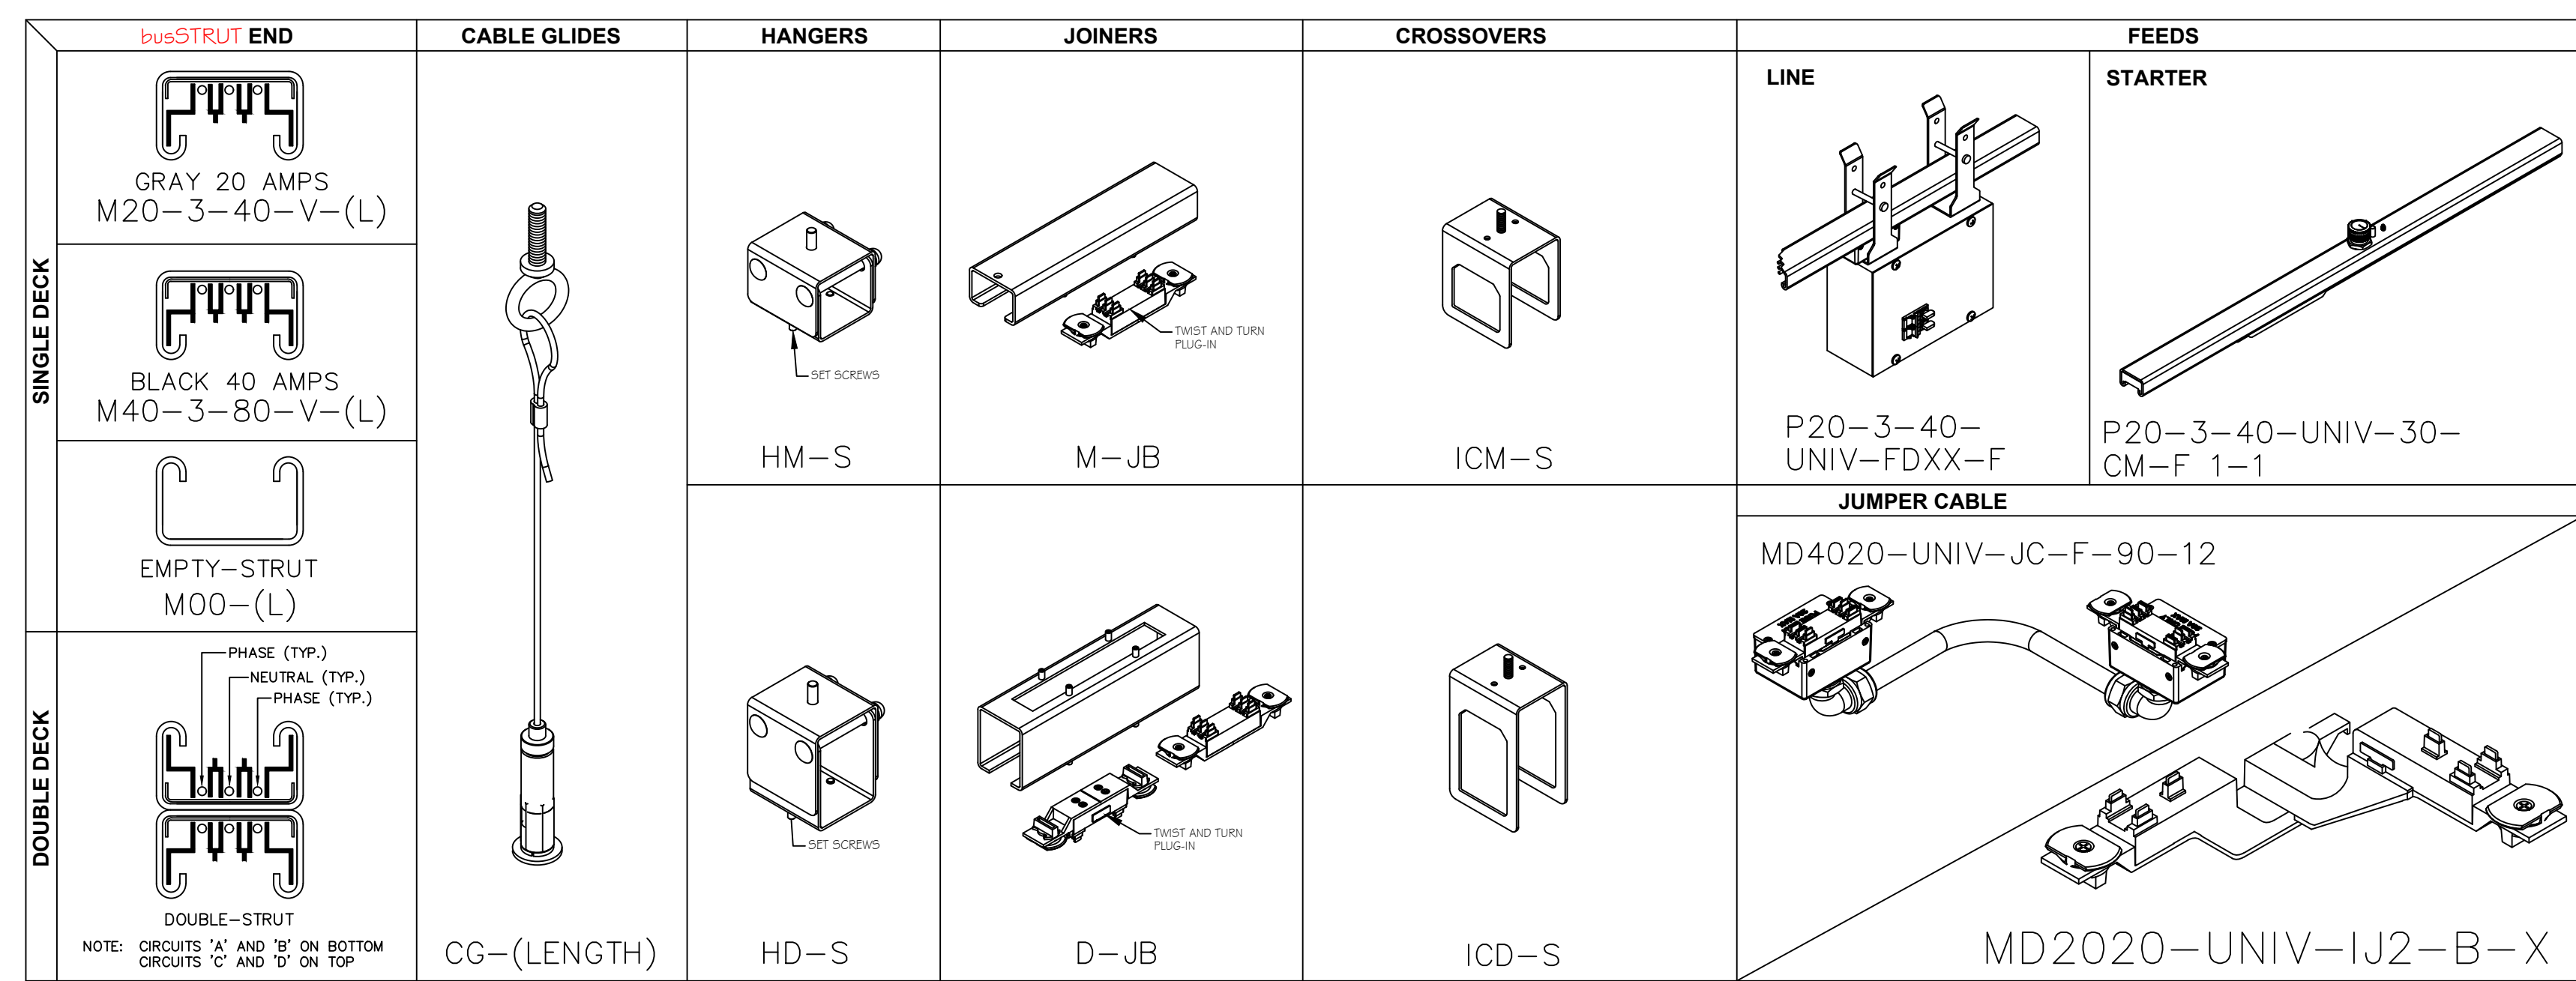

busSTRUT 12 gauge 1" x 1" x 1.58" STEEL. **busSTRUT** features two Hot wire symmetrically surrounding a center Neutral. The result, two 20 Amp circuits 40 Amps Maximum with **busSTRUT** (20) alternatively two 40 Amp circuits 80 Amps Maximum with **busSTRUT** (40). 2, 5, 10, and 20' lengths. Rated for up to 277/480V. Double decks with standard hardware for trunking.

BRAIDED CABLE with GUIDE: For use with **busSTRUT**. Hangers/Crossovers. Includes cable-glides and cable with factory assembled cable looped threaded 1/4-20" eye bolt.

HANGERS: Single and Double Hangers are for use with **busSTRUT**. Each is an assembled two-part unit. The upper piece includes a threaded stud for use with **busSTRUT** cable-glides.

JOINERS: Single and Double are for use with **busSTRUT**. Lengths are joined together mechanically with the 8" steel sleeve. Electrical Joiner-Kits include both a Turn & Turn Plug to electrical insert to bridge power. And continuous grounding wires through the bus itself by means of a permanently affixed copper grounding bar.


CROSSOVERS: For use with intersecting **busSTRUT**. Each is an assembled two-part unit for building grid configurations and bridges. The upper piece includes a threaded stud for use with **busSTRUT** cable-glides.

JUMPERS: For use with both **busSTRUT** (20) and **busSTRUT** (40). The fused 4002 Jumper Cables can be used to electrically connect **busSTRUT** (740) Trunks to **busSTRUT** (720) Branches and/or electrically connecting **busSTRUT** (720) to **busSTRUT** (720).

LINE FEEDS: For use with powering single-decked **busSTRUT**. Junction Box features energy code type "Tentative" (breakers/line holders) and 3 Pole Fuses. Available up to 277/480V. Can be positioned anywhere along **busSTRUT** to reduce the lengths of trunks.

STARTER FEEDS: For use with powering single-decked **busSTRUT**. Utilized when no current limiting is required on the **busSTRUT**. Must be positioned at the beginning of a run.

Lights

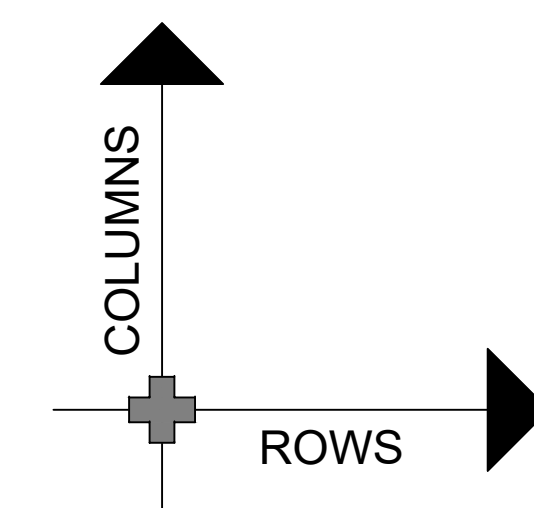


Legend

- busSTRUT 20 / Single Deck
- 30" Starter Feed
- Joiner
- 1/1 Slimline Crossover
- Slimline Jumper

Lighting Plan

busSTRUT LIGHTING PLAN ONLY
THIS DRAWING IS MEANT TO SHOW THE LOCATION OF **busSTRUT** LIGHTS ONLY. IT IS NOT A REPLACEMENT FOR: ARCHITECTURAL / ENGINEERING / ELECTRICAL SPECIFICATIONS. (SEE THEIR DRAWINGS)

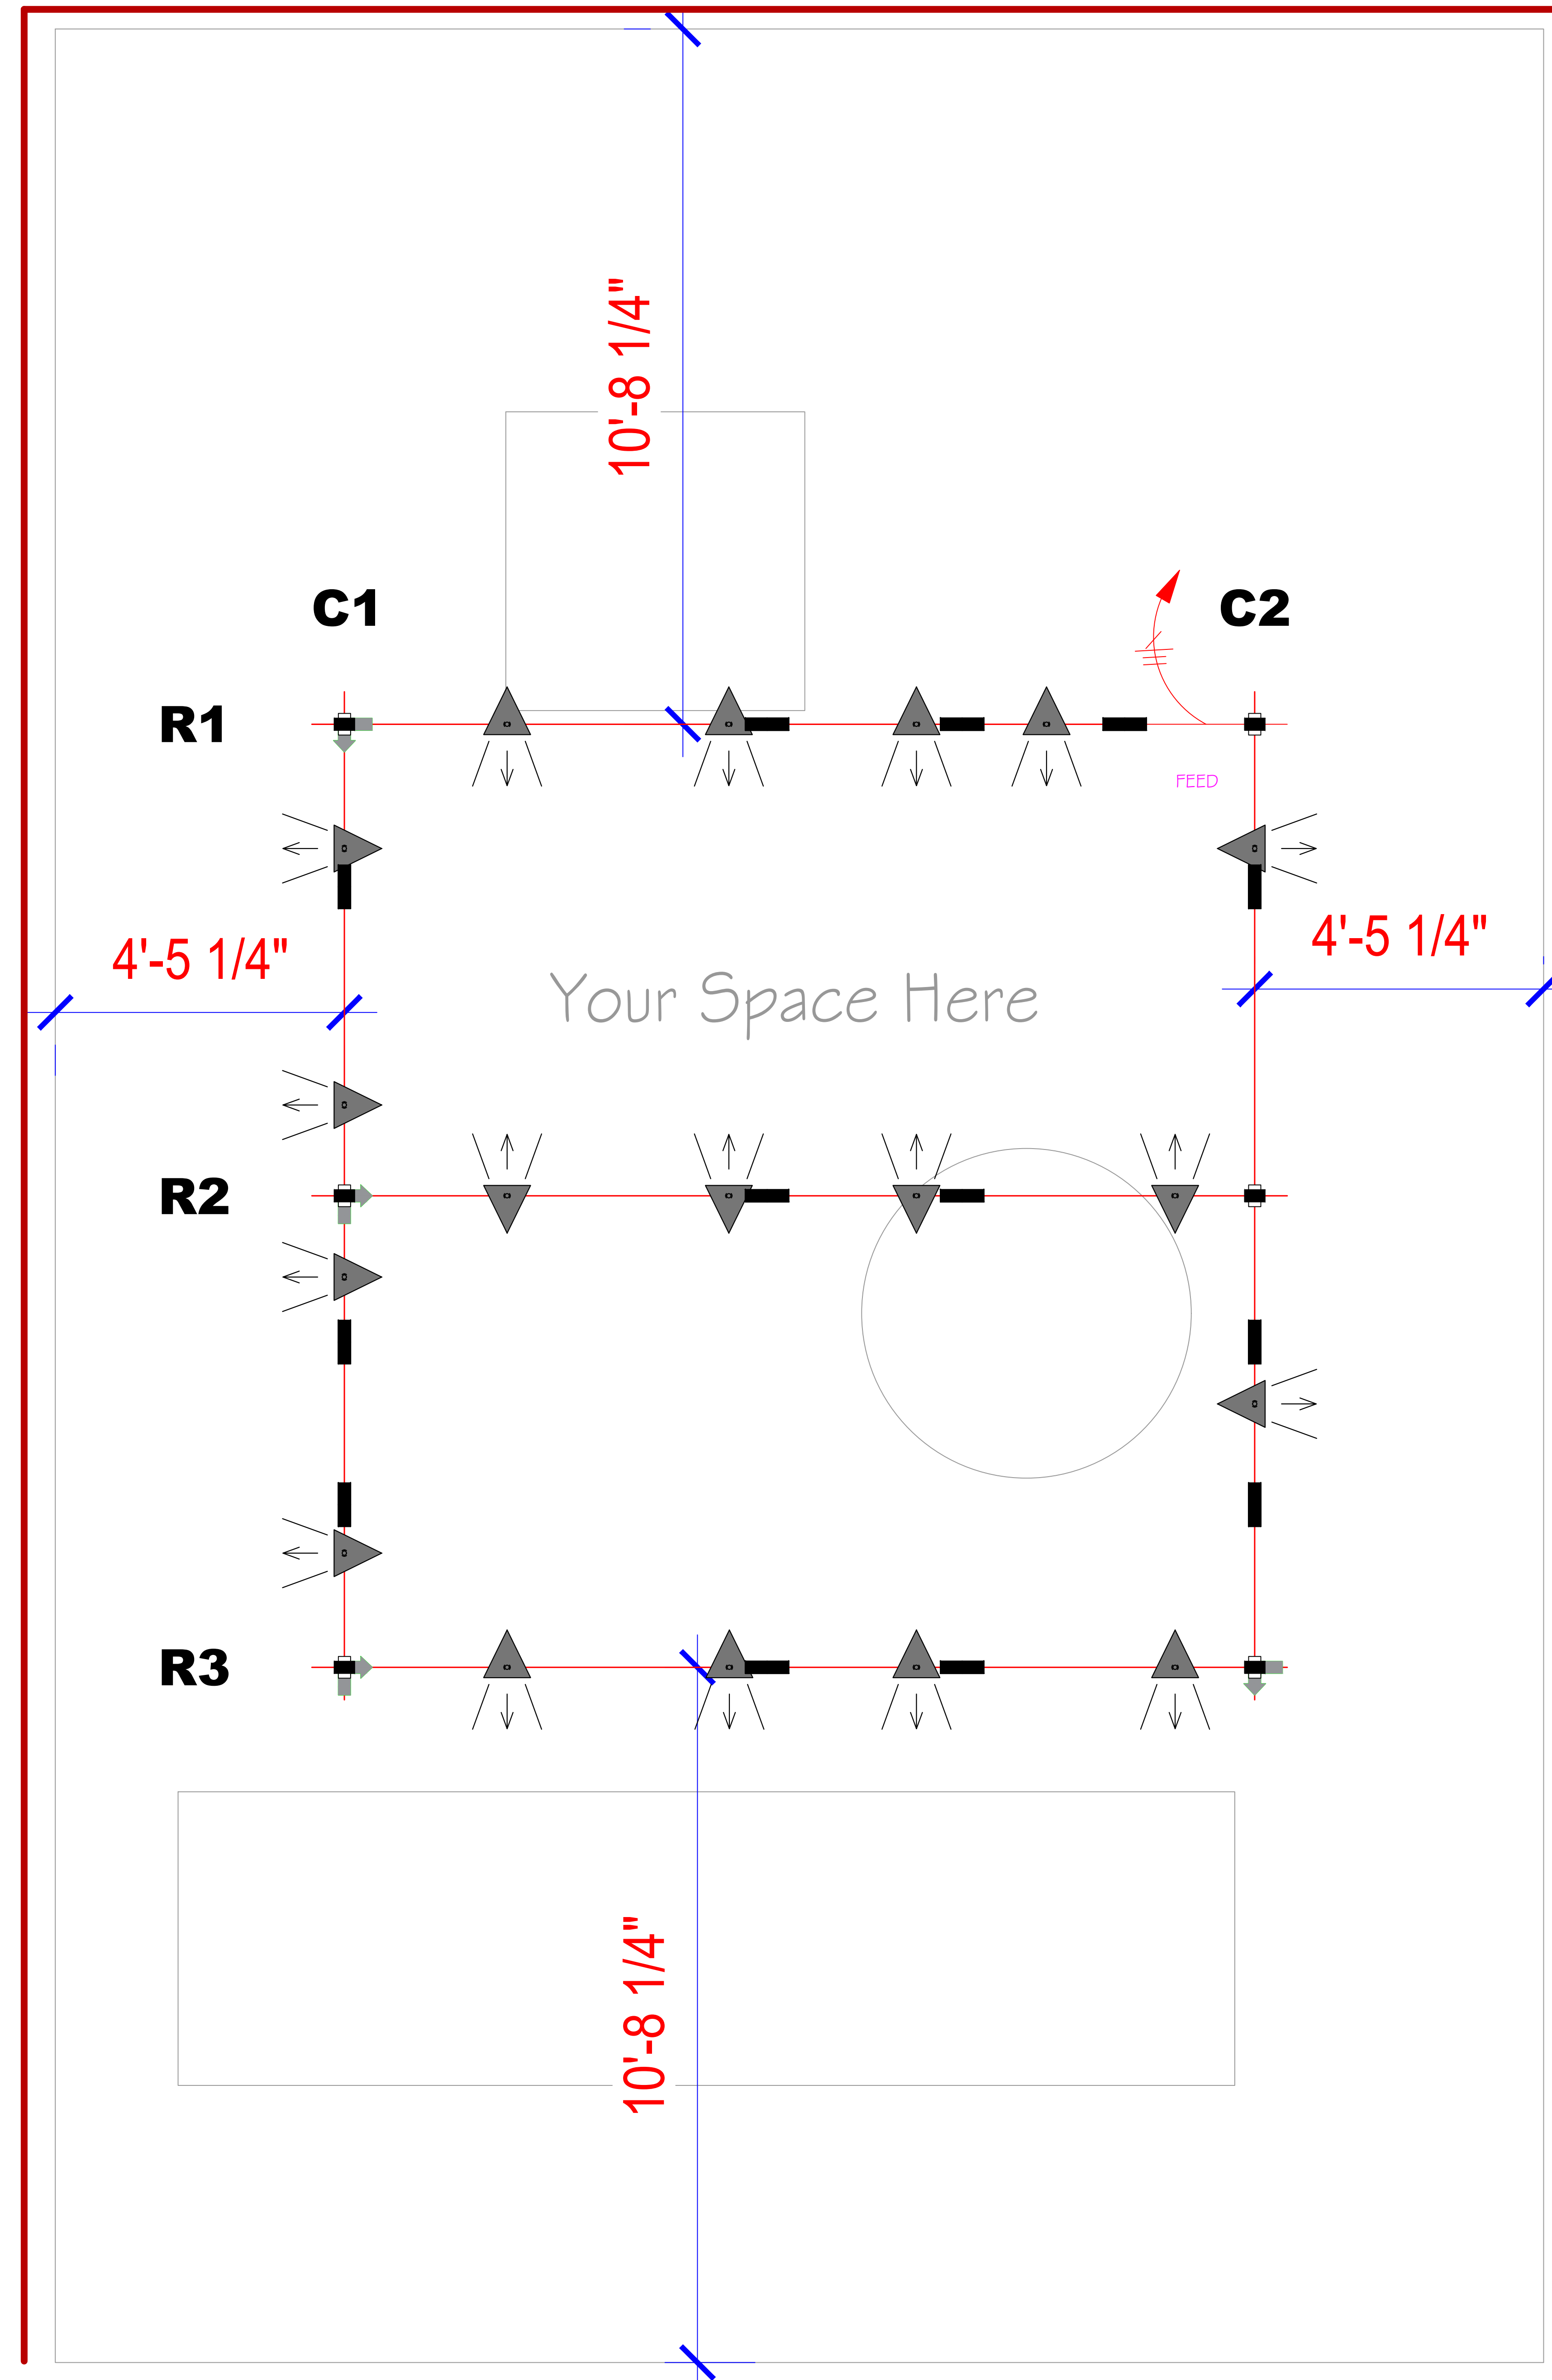

Bill of Materials

busSTRUT Bill of Materials															Drawn By	John Loch					
ROWS Medium Design															Checked By	John Loch					
															Date	10/15/2024					
R/C	Amps	LF	BF	busSTRUT LENGTHS				busSTRUT Hardware					busSTRUT POWER				GEN	ACT			
				M20-3-40-277-2.5-F-2B	M20-3-40-277-3-F-2B	M20-3-40-277-5-F-2B	M20-3-40-277-7-F-2B	M-JB-F-X	M-JI-F-X	M-JI-F-NE	HM-S-F-ST-LFX	CG-E-15-B-GL	ICM-S-F-ST-X	MD4020-UNIV-JCF-90-12-GO2	MD2020-UNIV-IJ2-F-X	P20-3-40-UNIV-JK-1B-F			P20-3-40-UNIV-30-CM-F-1-1	P40-3-60-UNIV-FD-F	
R/C	Amps	LF	BF	2.5	3	5	7	M	INS	NE-INS	M	C-GI	1/1	12"	INVS	JK	30ST	40	WW	LUCY	
R1	20	15	15	1	1	1	1	3	3			1	3	2			1				4
R2	20	15	15		1	1	1	2	2			1	3	2							4
R3	20	15	15		1	1	1	2	2			1	3	2		1					4
SUB TOTAL		45	45	1	3	2	3	7	7			3	9	6		2	1				12
C1	20	15.5	15.5	1	2		1	3	3							1					4
C2	20	15.5	15.5	1	2		1	3	3							1					2
SUB TOTAL		31	31	2	4		2	6	6						2						6
STORE TOTAL		76.0	76.0	3	7	2	5	13	13			3	9	6		4	1				18

Labor Hours


busSTRUT provides time-tested standard labor hours per part, which are then multiplied by the project's Bill of Materials.

busSTRUT LABOR					
ITEMS	Qty.	U/M	STANDARDIZED LABOR HOURS		TOTAL HRS
			MIN	HRS @0	
LENGTHS	76	LF	2.75	0.05	3
JOINERS	8	EA	12	0.20	2
HANGERS	9	EA	25	0.42	4
CROSSOVERS	6	EA	10	0.17	1
ATTACHMENTS		EA	8	0.13	0
JUMPERS	4	EA	6	0.10	0
FEEDS	1	EA	15	0.25	0
busSTRUT SUB-TOTAL					10
ACCENT	18	EA	8	0.13	2
LINEARS		EA	20	0.33	0
busSTRUT READY LIGHTS SUB-TOTAL					2
TOTAL TIME					13


busSTRUT system is designed to be BID separately.

Bid from the feeds-in.


* Powered by a minimal amount of feed boxes.

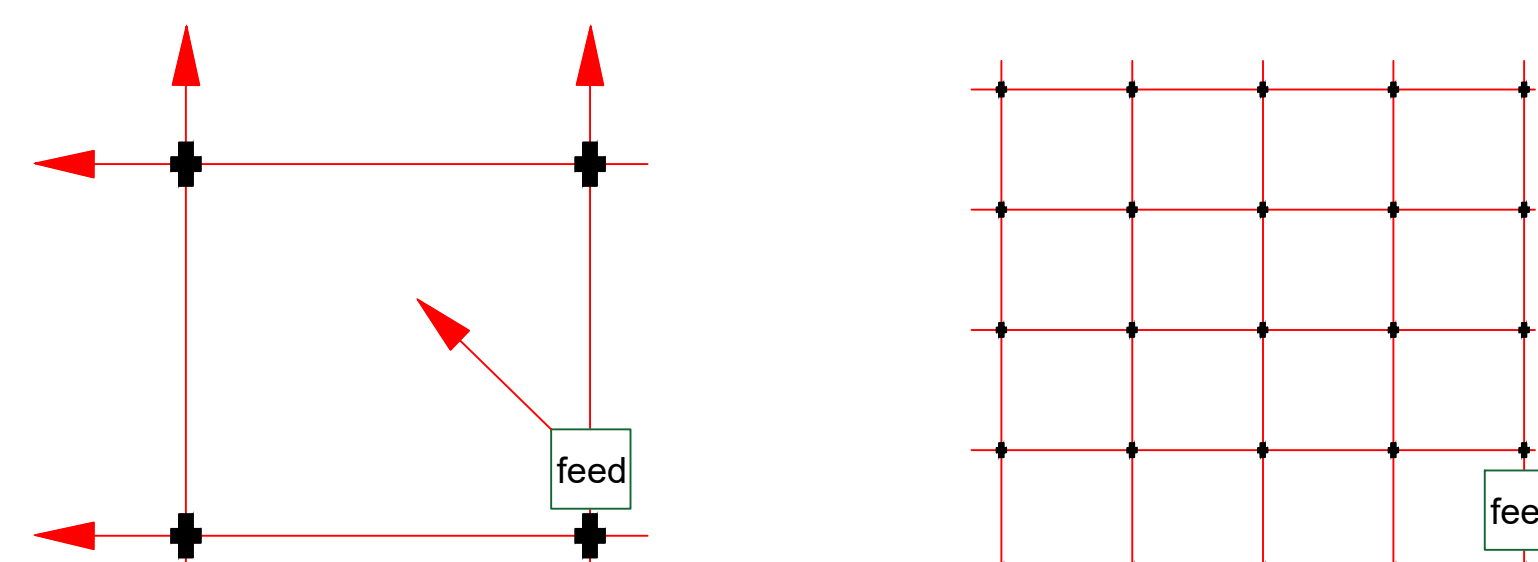

Mounting Rules

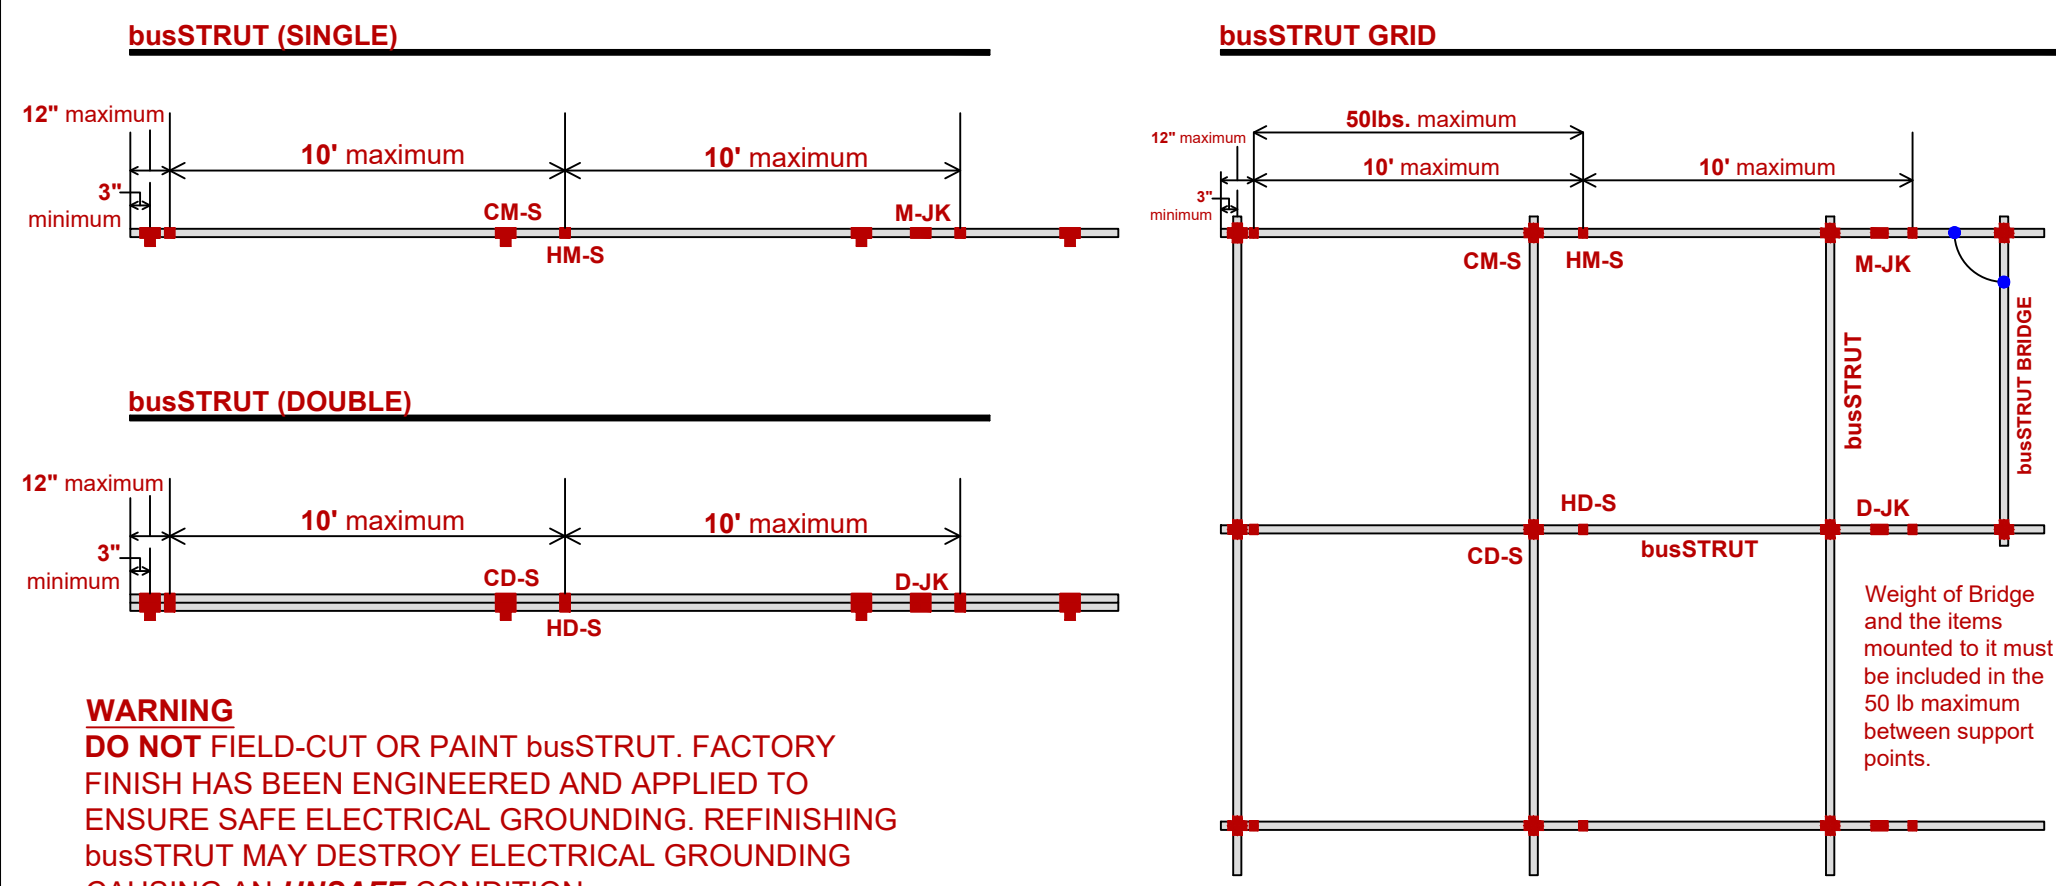


WARNING
 DO NOT FIELD-CUT OR PAINT busSTRUT. FACTORY FINISH HAS BEEN ENGINEERED AND APPLIED TO ENSURE SAFE ELECTRICAL GROUNDING. REFINISHING busSTRUT MAY DESTROY ELECTRICAL GROUNDING CAUSING AN UNSAFE CONDITION.

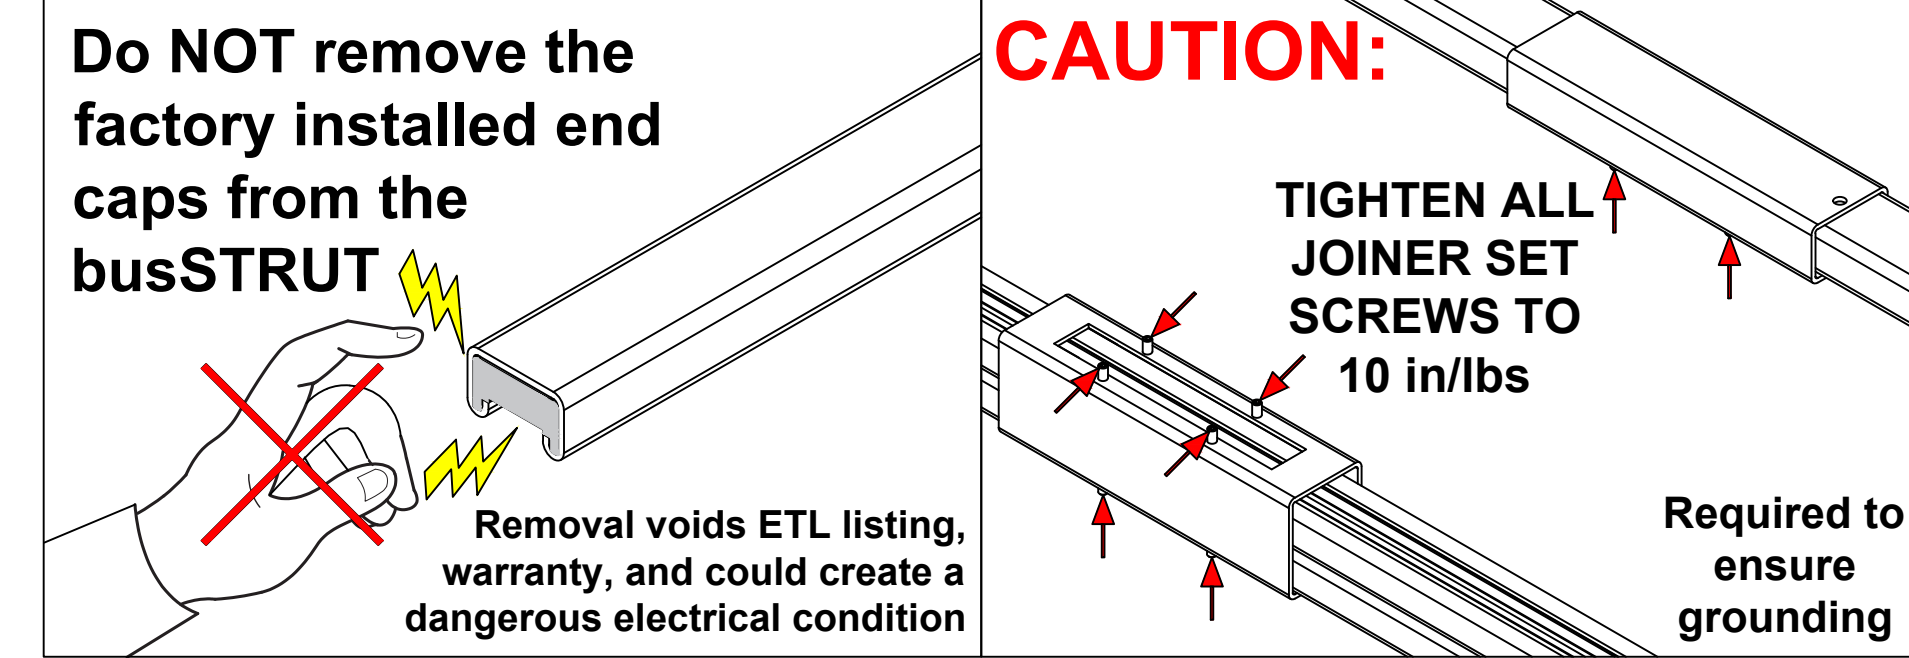


- DISTANCE:**
 10' MAXIMUM 10' spacing between support points
- 12" Support point must be within 12" from every end or corner
- 3" MINIMUM 3" of busSTRUT to be exposed beyond end of mounting hangers and/or crossovers
- WEIGHT:**
 50 lbs Maximum 50 pounds between support points (Include weight of busSTRUT System)
 Weight of 1 foot of busSTRUT:
 Single (MIN) - 1.5 lb per Linear Foot (not including connected weight)
 Double (MAX) - 3 lb per Linear Foot (not including connected weight)
- FITTERS**
 40 lbs The busSTRUT Flip-Fitters (with metal bracket) are rated for 40 lbs maximum static, vertical load.
 Flip-Fitters without metal bracket are for use with standard track light fixtures only. Consult for maximum weight restrictions.
- Only busSTRUT fittings and hardware may be mounted directly to busSTRUT.

CONNECTION TO STRUCTURE BY OTHERS
 Attachment from busSTRUT System to structure must be engineered and installed to properly support the entire suspended weight.

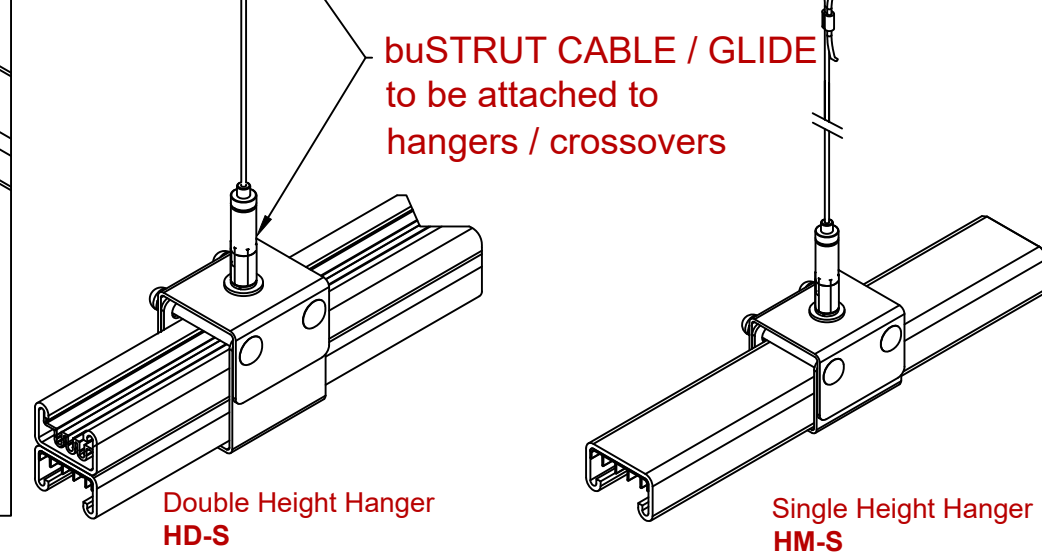


Legend


	busSTRUT 20 / Single Deck
	30" Starter Feed
	Joiner
	1/1 Slimline Crossover
	Slimline Jumper

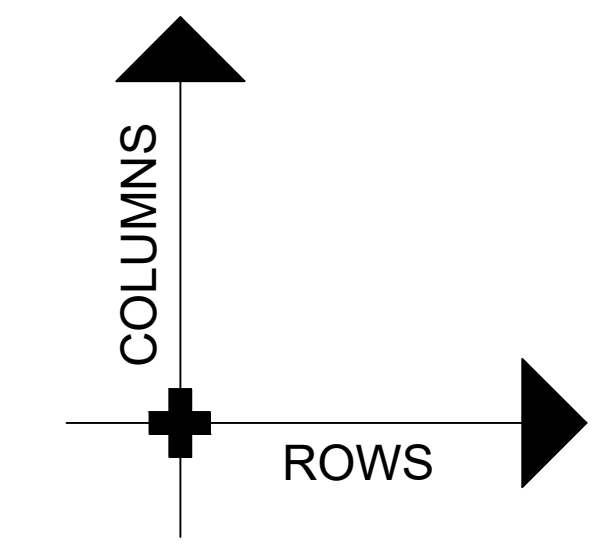


Dimensions

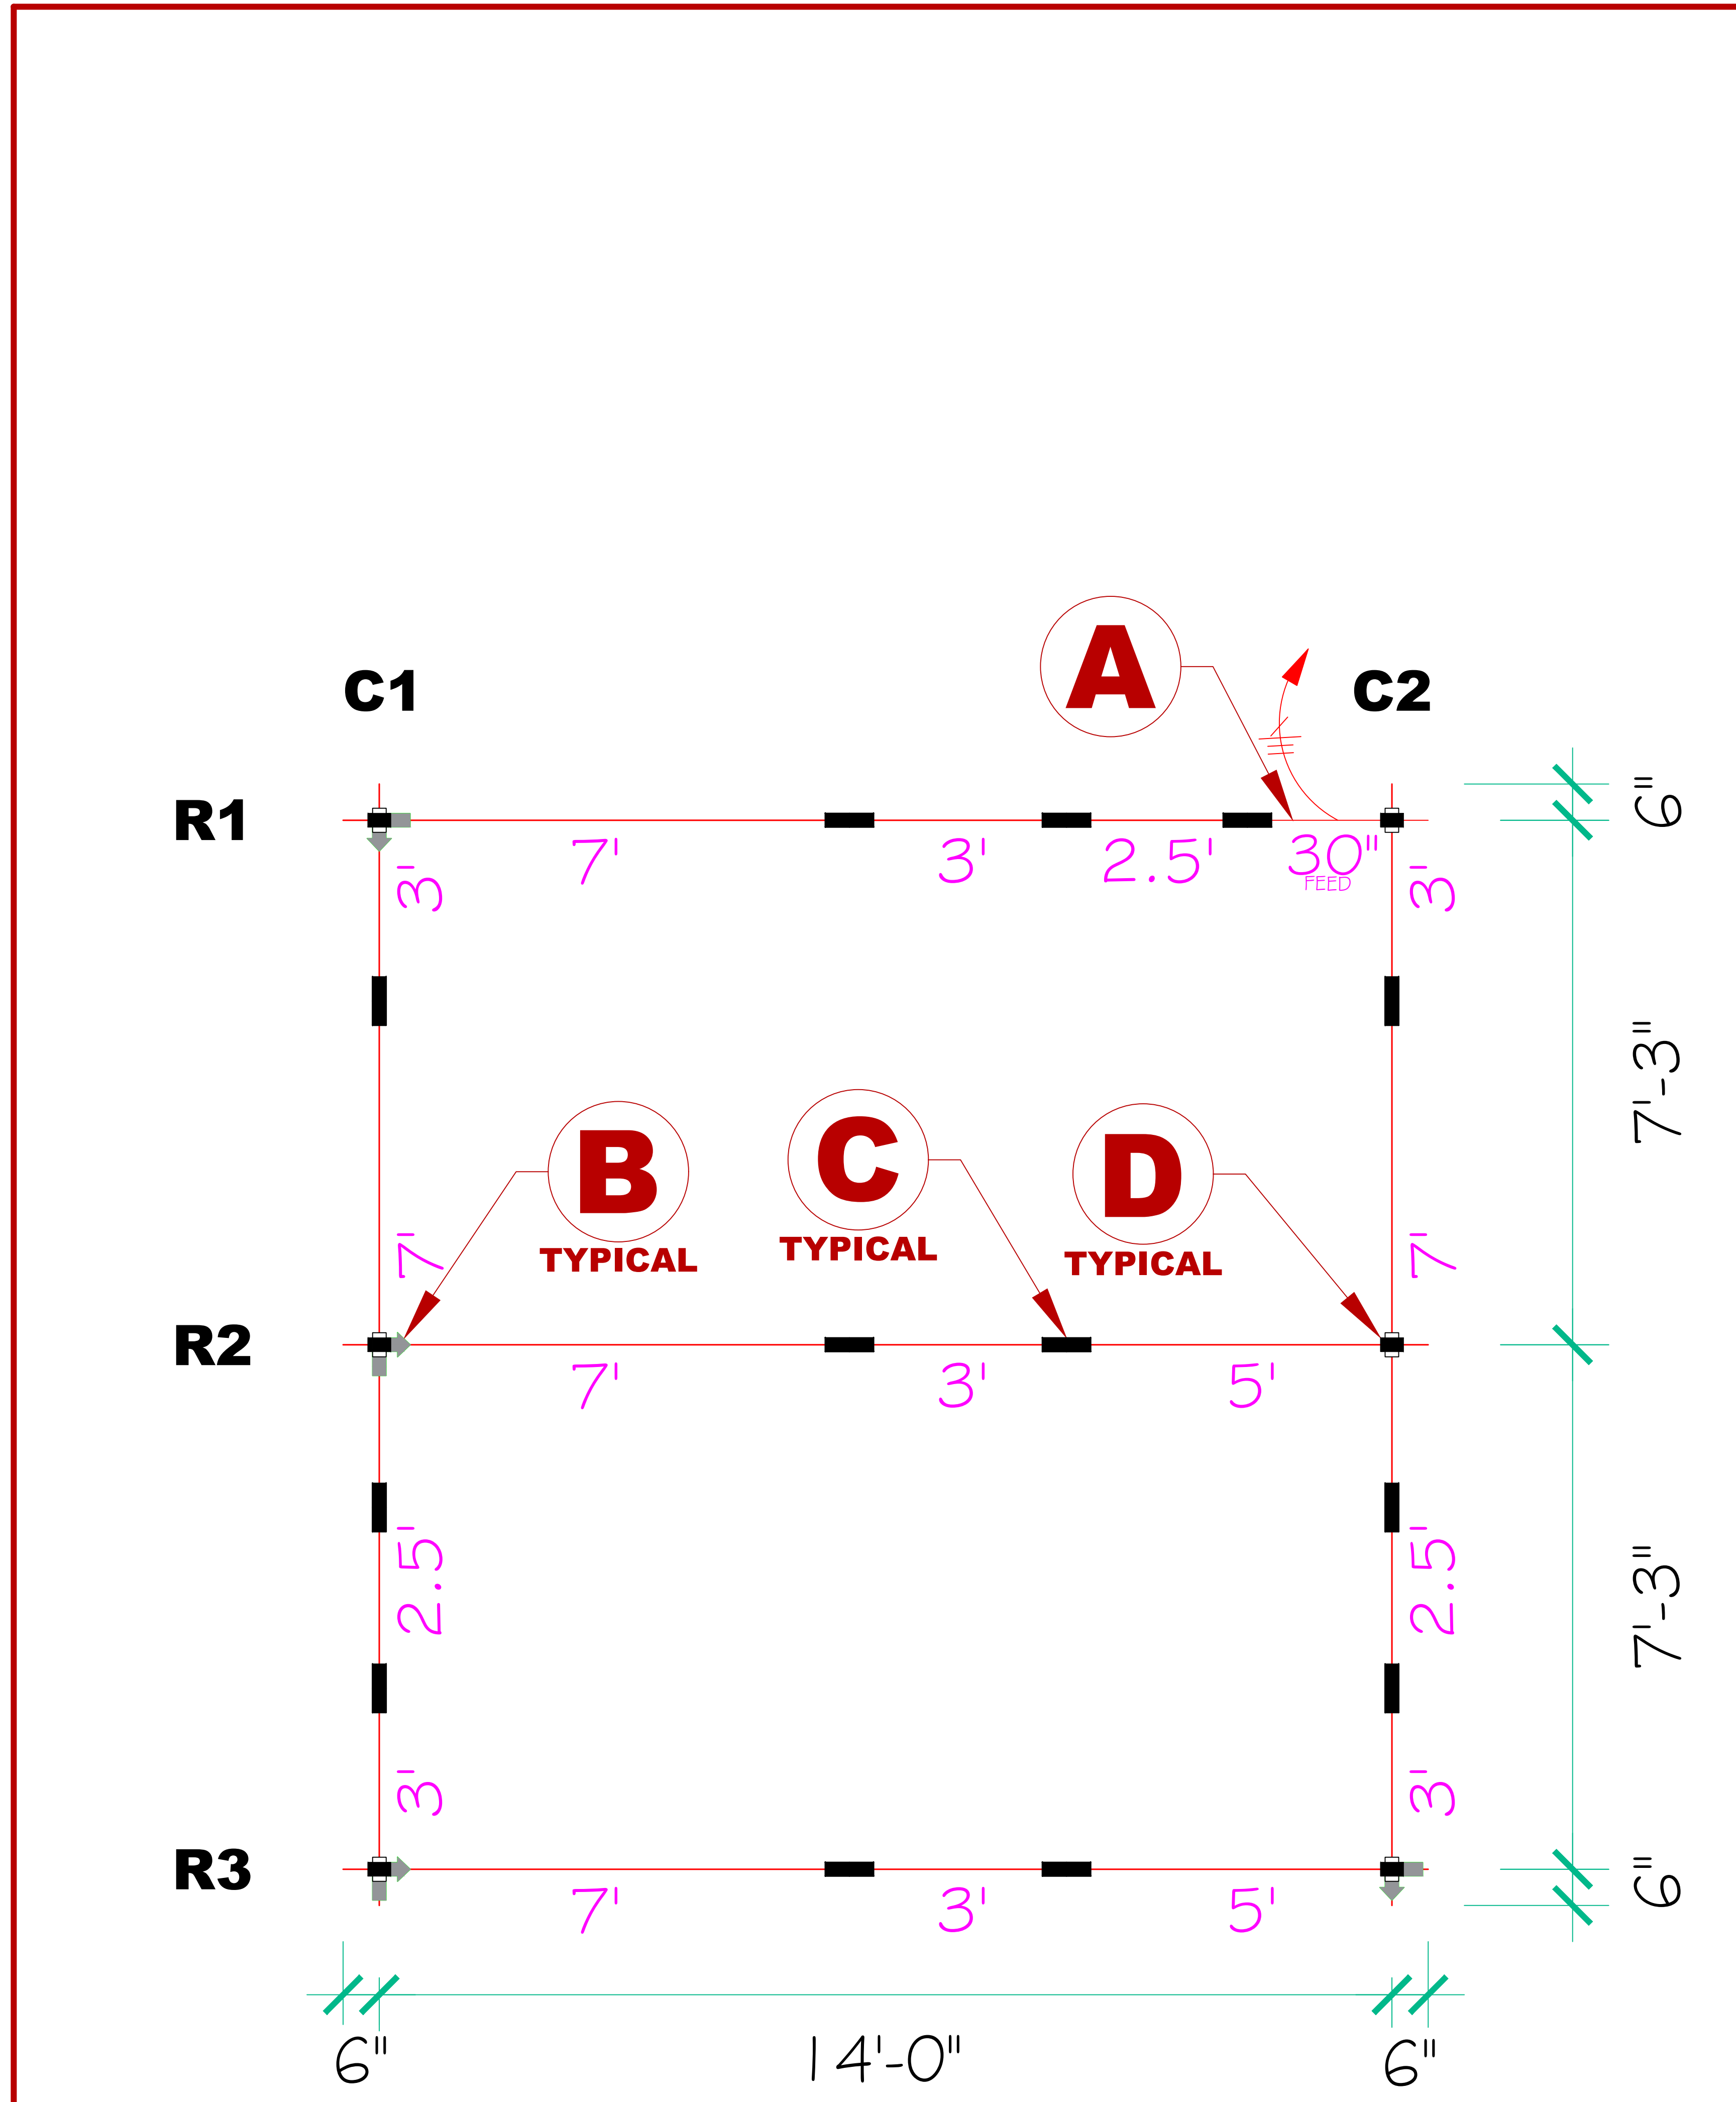


Project Specific Rules

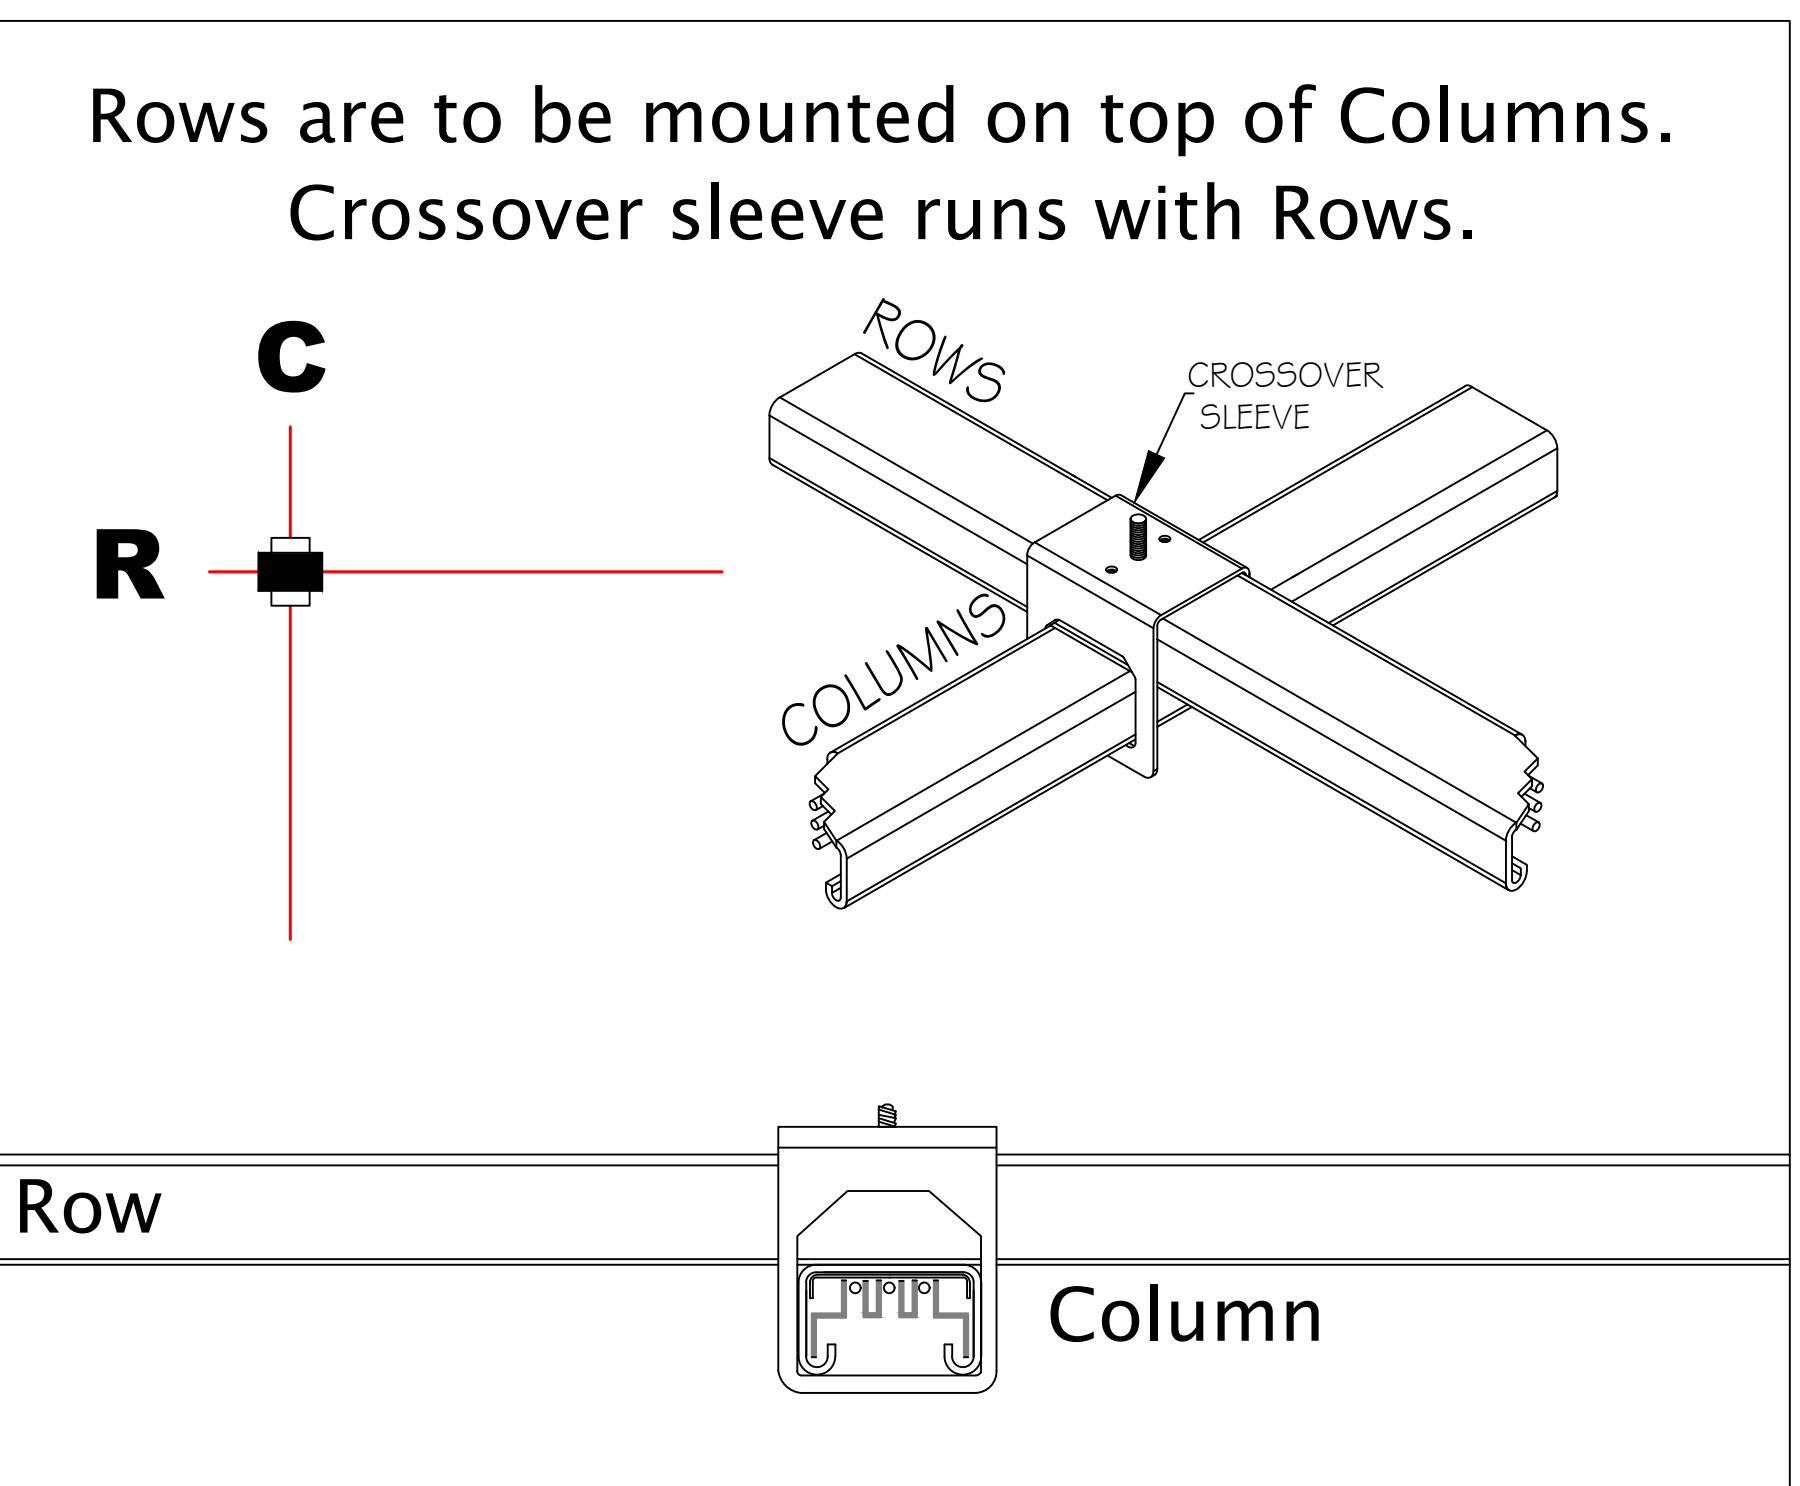

ISO Details

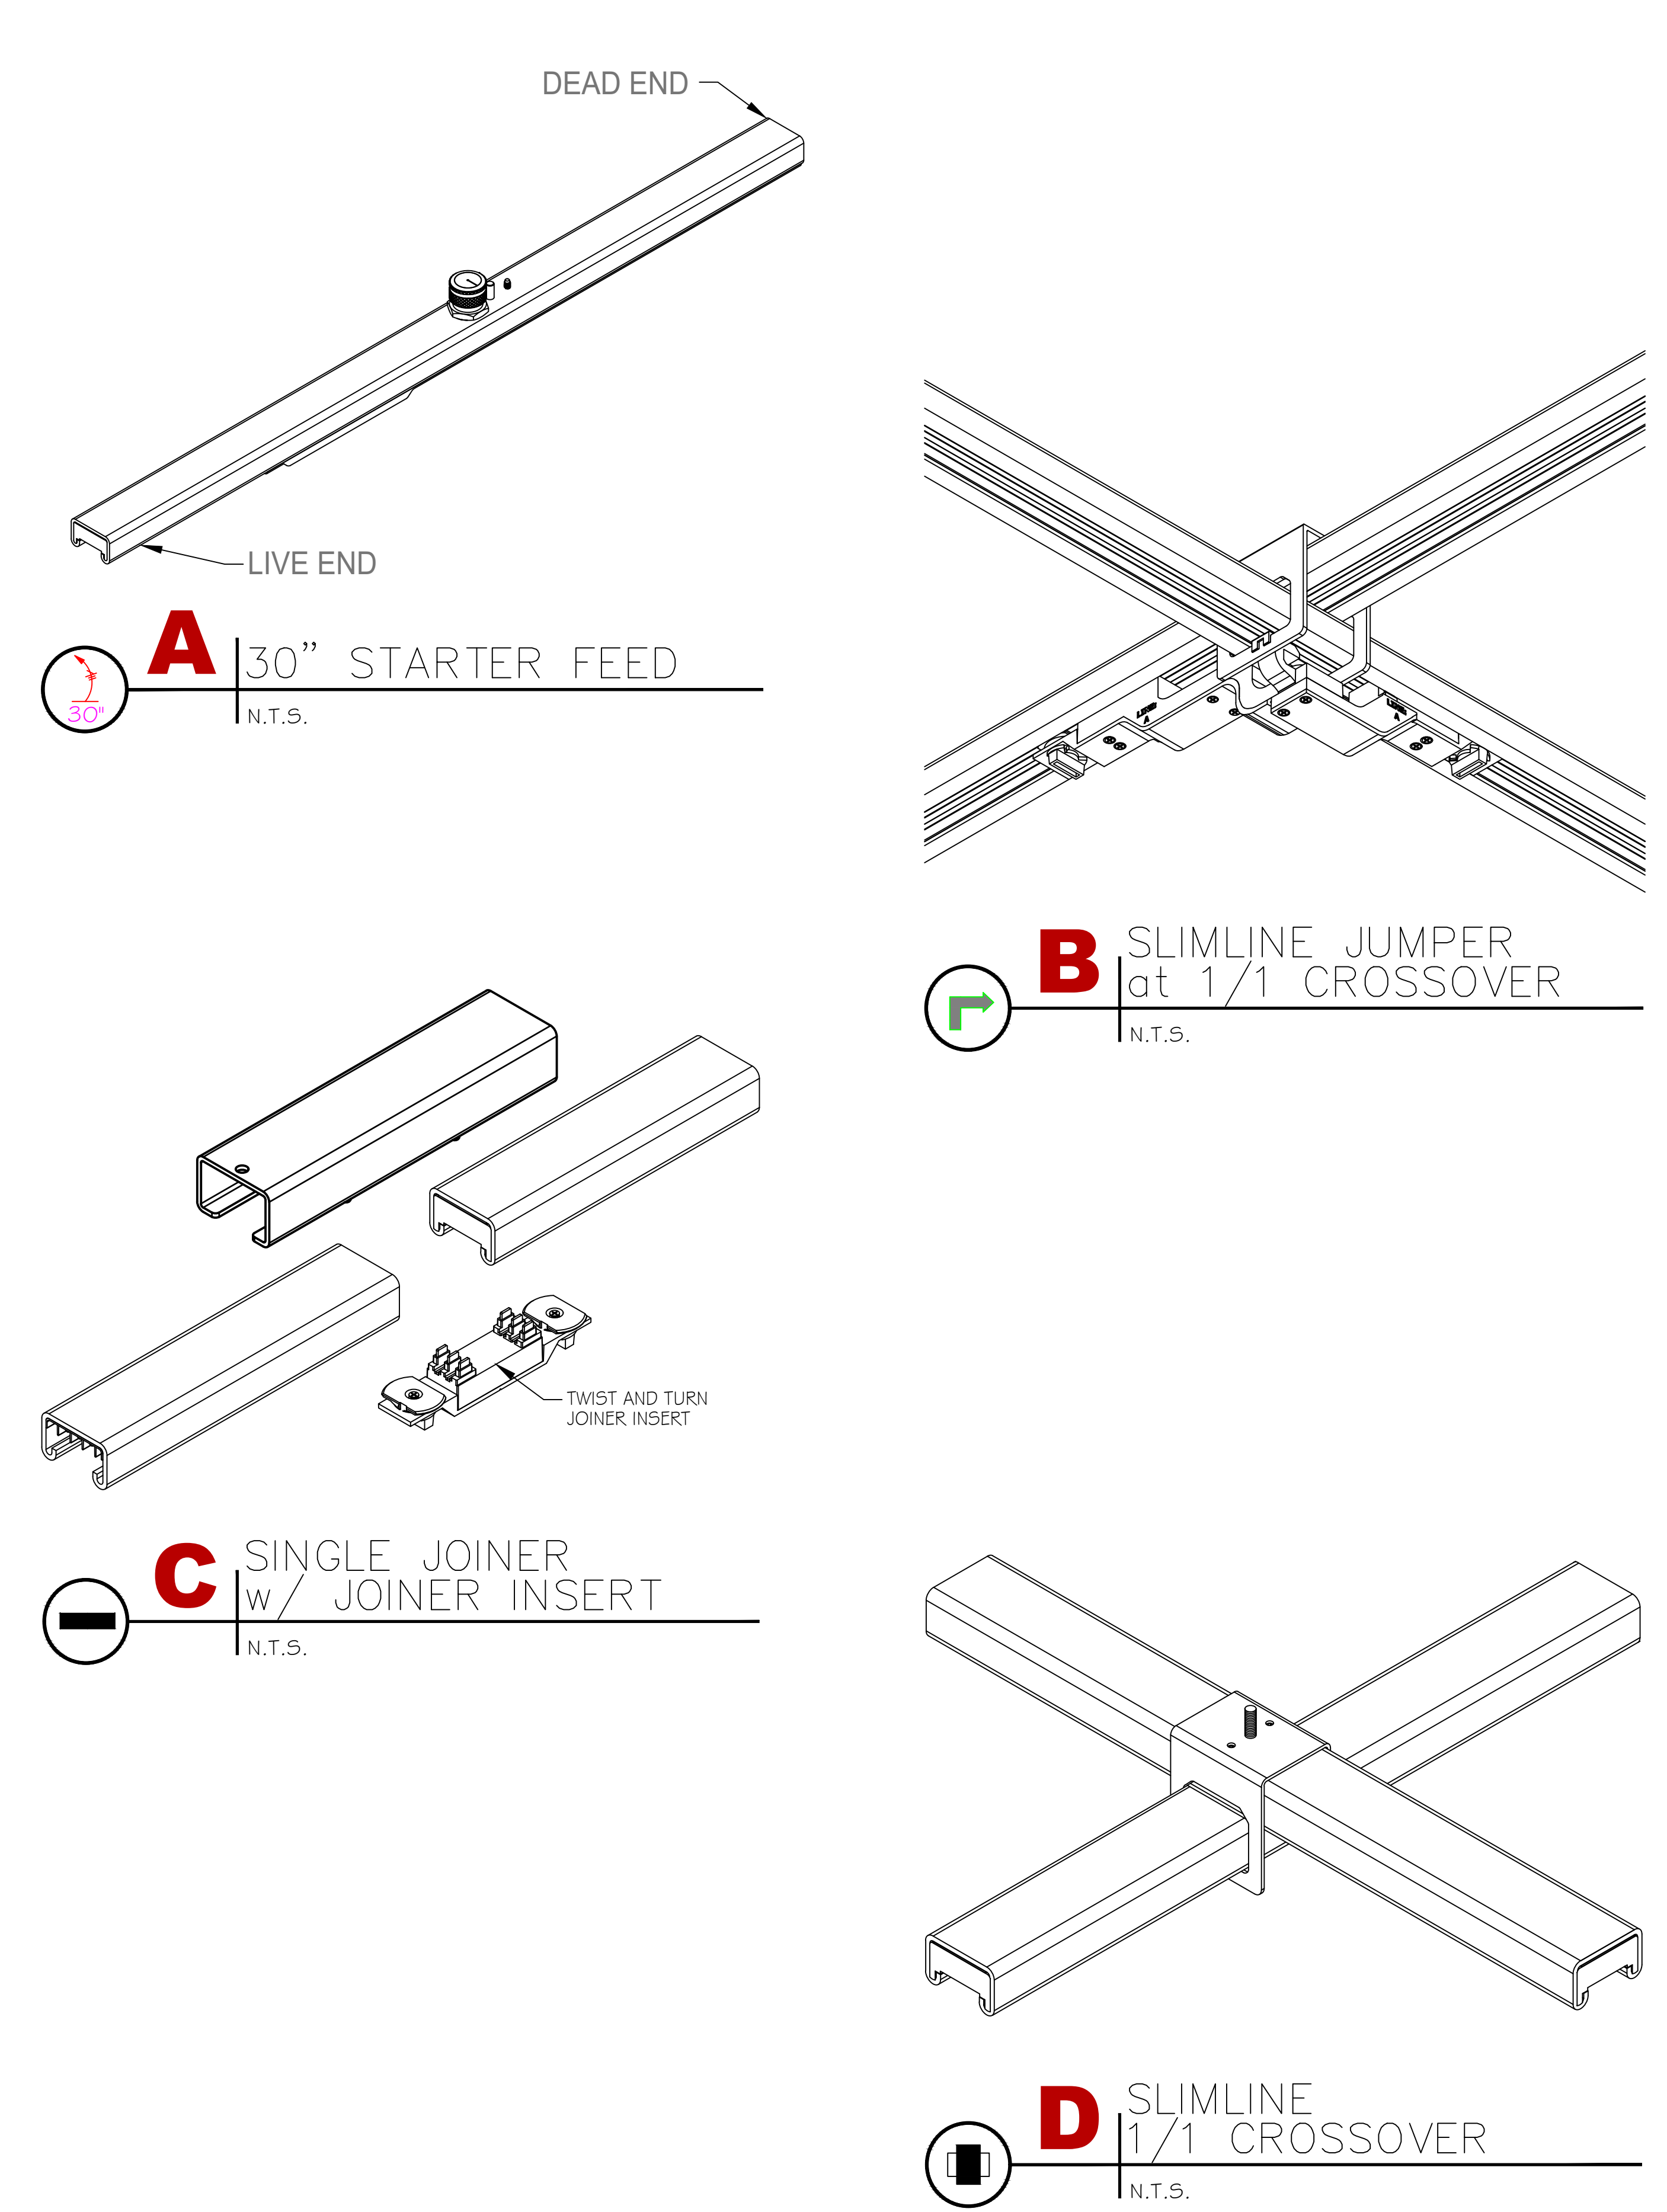

- busSTRUT Lengths Used in this Project**
- 2.5'
 - 3'
 - 5'
 - 7'

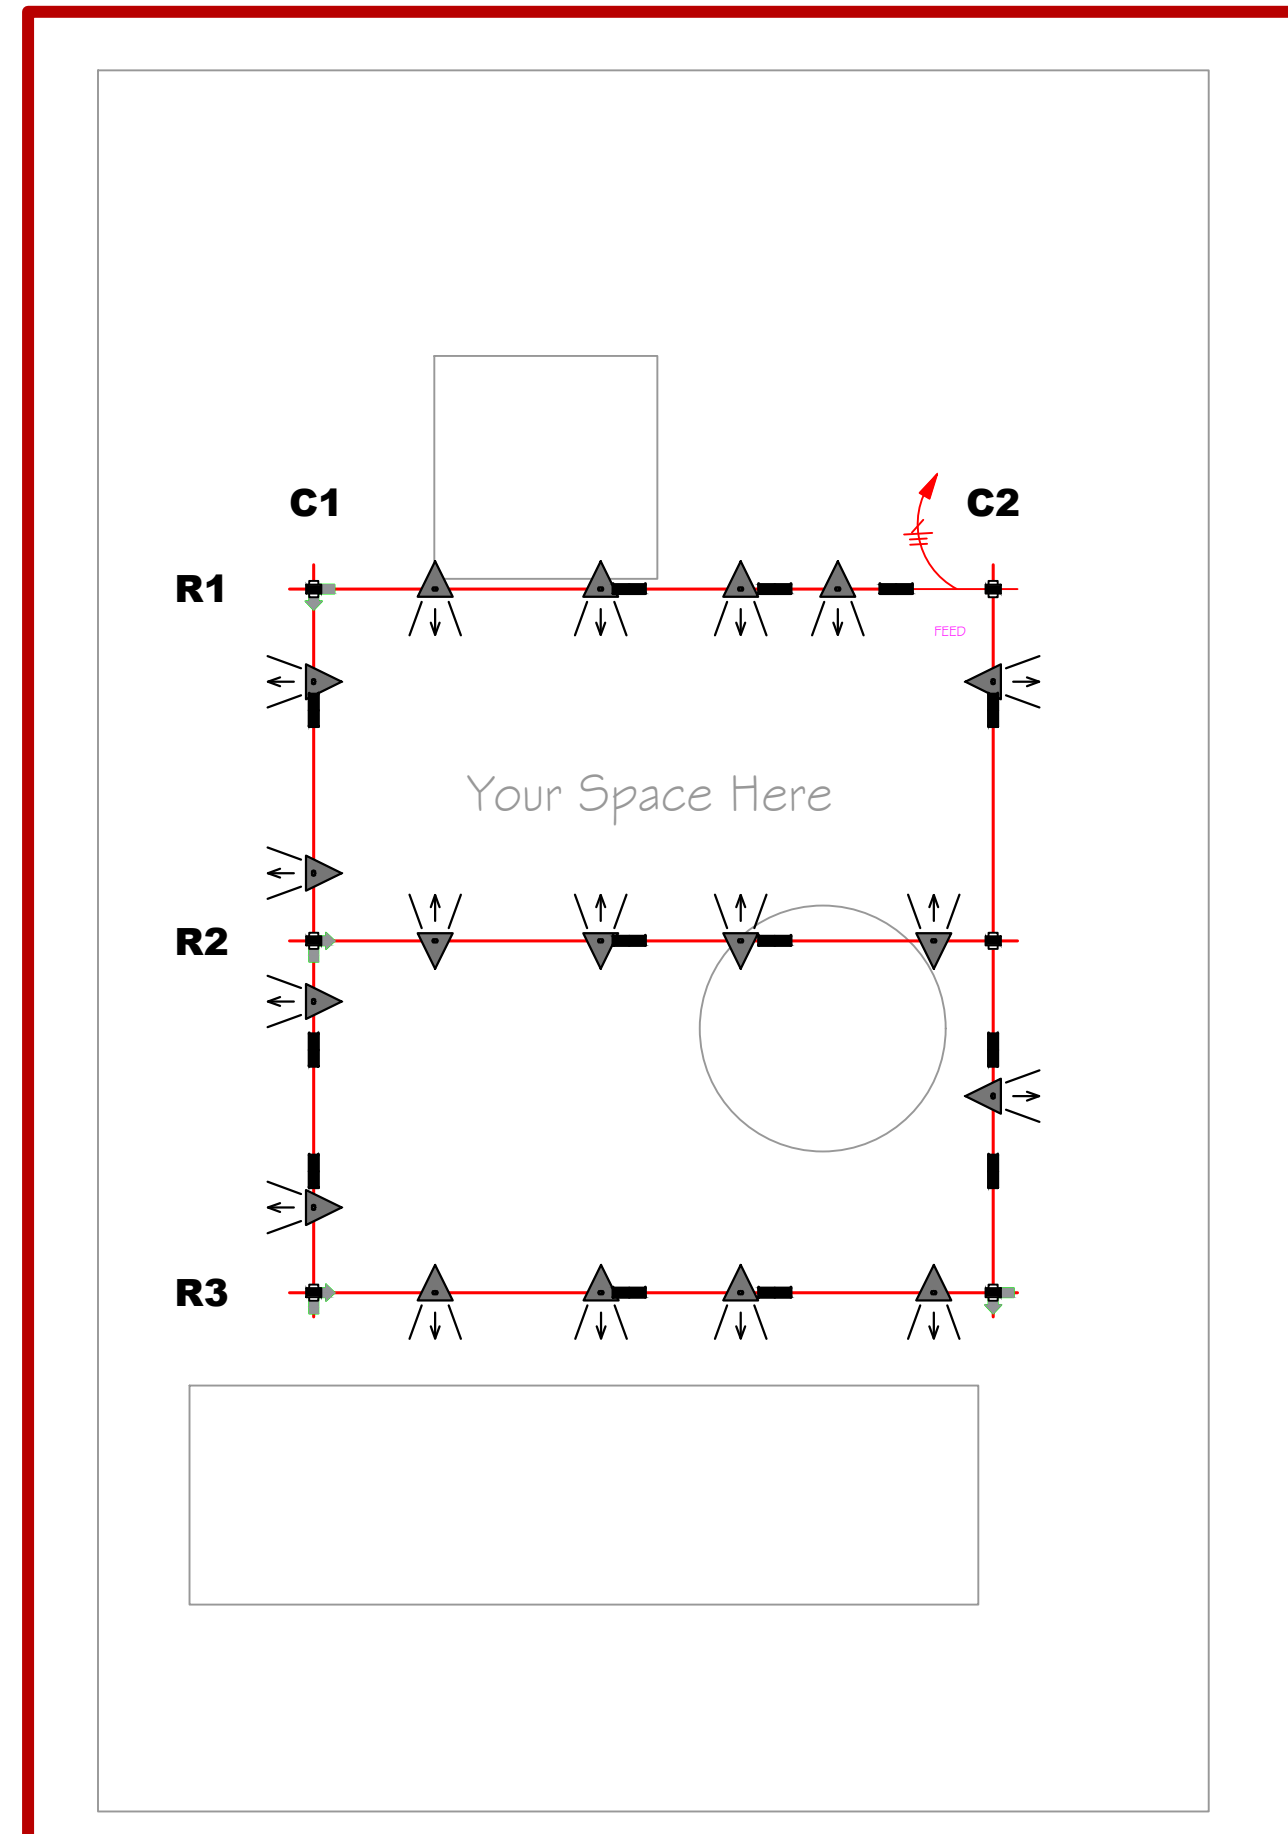

bs
 busSTRUT
 805 Hillside Road
 Westerville, OH 43081
 TEL: 614-933-8695
 E-MAIL: INFO@BUSSTRUT.COM
 WWW.BUSSTRUT.COM

PREPARED BY: LARRY GELLERT
 CHECKED BY: JOHN LOCH
 DRAWN BY: JOHN LOCH
 DATE: 10/15/2024
 REVISION: BID/REVIEW

Assembly Plan

Rectangle Grid

busSTRUT DRAWING SET (ONLY) STOP HERE! NO FURTHER PROGRESS FOR ARCHITECTURAL, ENGINEERING OR ELECTRICAL DRAWINGS

NO.	DATE	REVISION DESCRIPTION	BY

PAPER SIZE: ARCH E (48x36)
 SCALE 3/4" = 1'-0"
 DRAWING NUMBER: E-b2